

Report No.: 51.03511 Recessed Downlight Test Time: 2023-07-01 19:42

Luminaire Property

Luminaire Category: Bridgelux V4HD 3000K CRI90
Luminaire Description: 36D
Current: 0.056 A
Power Factor: 0.536
Voltage: 214.7 V
Power: 6.50 W


Photometric Results

CIE Class: Direct
Measurement Flux: 446.8 lm
Downward Ratio: 100%
Horizontal Diffuse Angle(50%): H37
Vertical Diffuse Angle(50%): V37
Luminaire Efficacy Rating (LER): 69
Max. Intensity: 922.06 cd


Total Rated Lamp Lumens: 446.8 lm
Efficiency: 100%
Upward Ratio: 0%

Central Intensity: 912.68 cd
Pos of Max. Intensity: H0 V5



Picture Of Luminaire



Luminous Intensity Distribution Curve

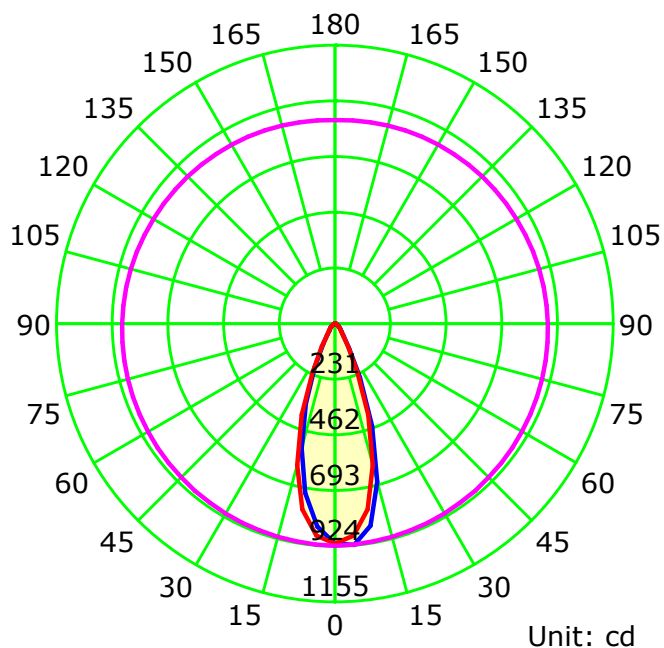


Luminous Intensity Distribution Curve

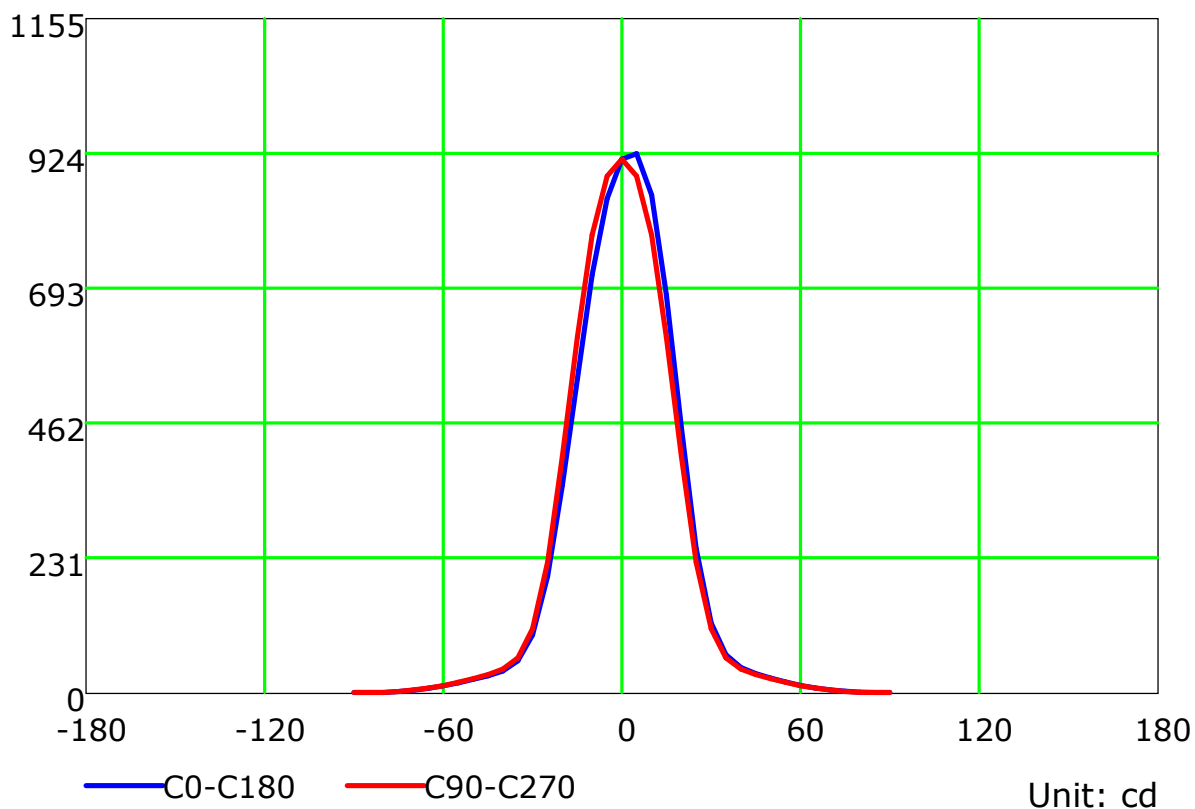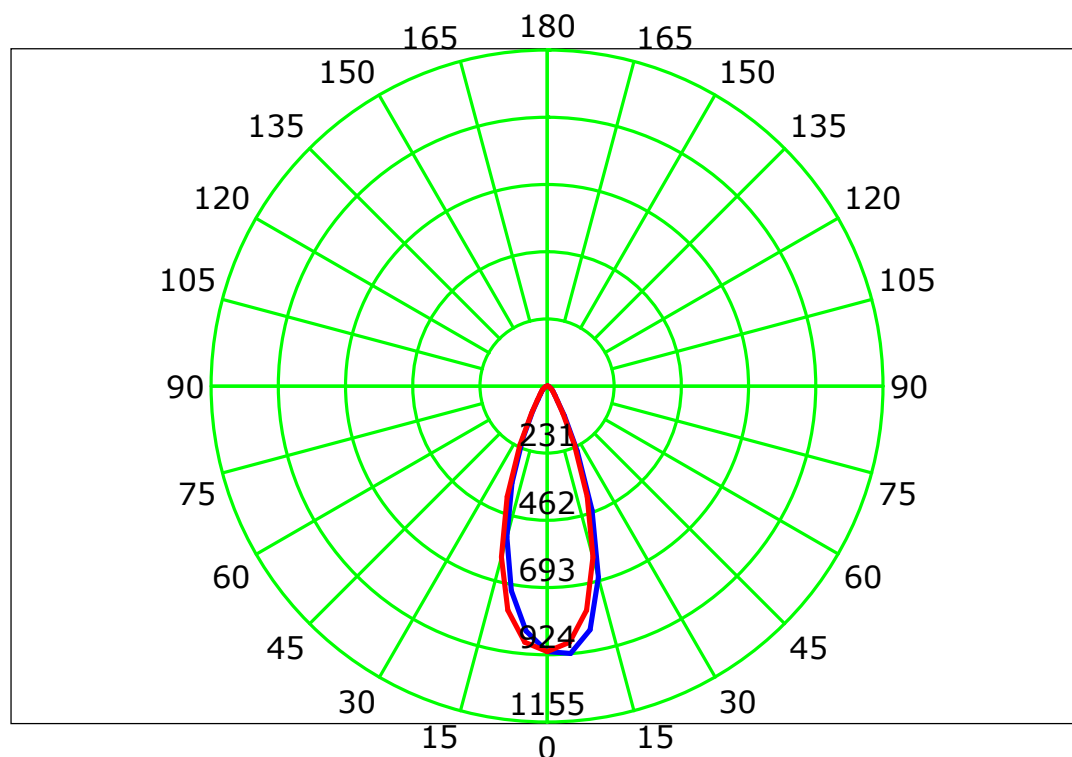

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:5.0
Test Device: CHL-6E
Distance: 3.000 m
Humidity:
Inspector:

Isocandela (rectangle)

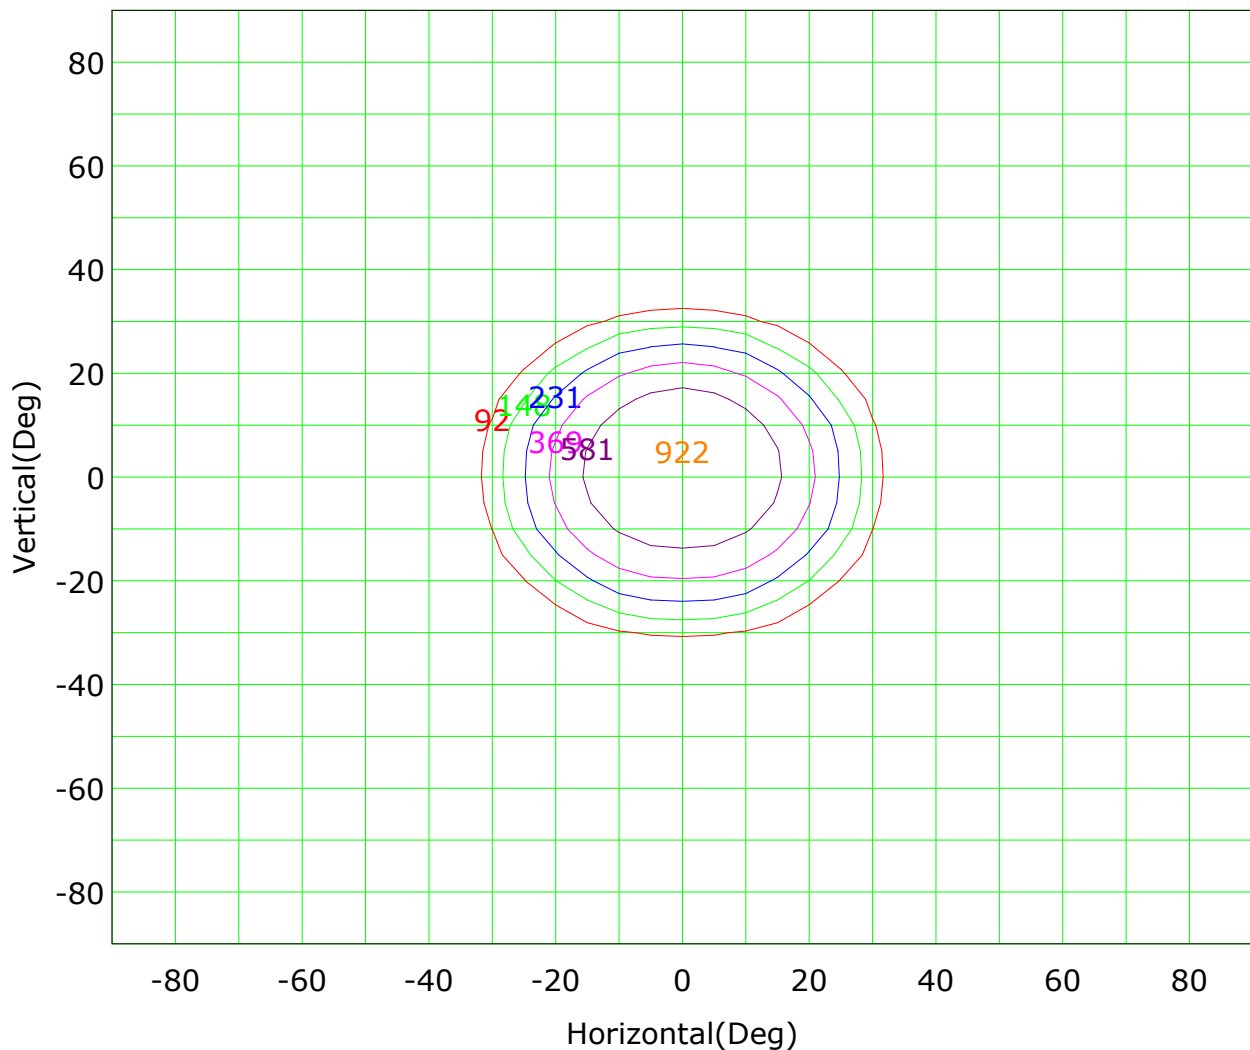

Imax (100%): 922 cd

(10%): 92 cd	(16%): 148 cd
(25%): 231 cd	(40%): 369 cd
(63%): 581 cd	(100%): 922 cd

C Plane (°):0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:5.0


Test Device: CHL-6E

Distance: 3.000 m

Humidity:

Inspector:

IsoLux Plot

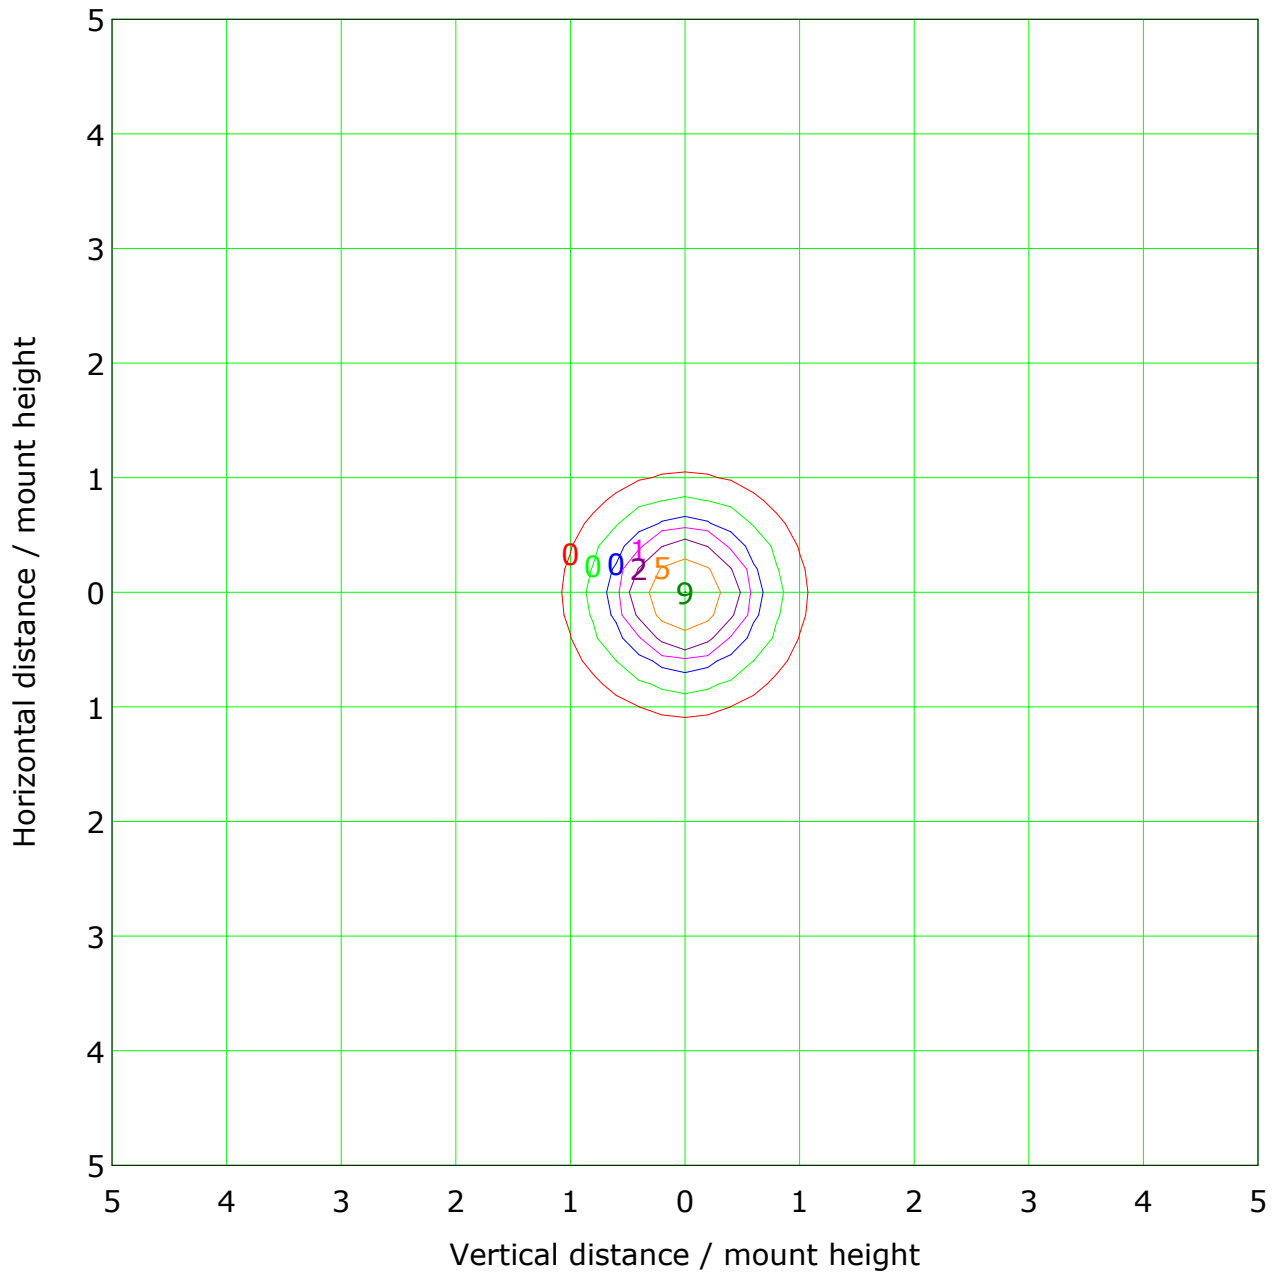

Mounting Height: 10m Max Lux(100%): 9 lx

(1%):	0 lx	(2%):	0 lx
(5%):	0 lx	(10%):	1 lx
(20%):	2 lx	(50%):	5 lx
(100%):	9 lx		

C Plane (°):0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:5.0


Test Device: CHL-6E

Distance: 3.000 m


Humidity:

Inspector:

Illuminance at a Distance

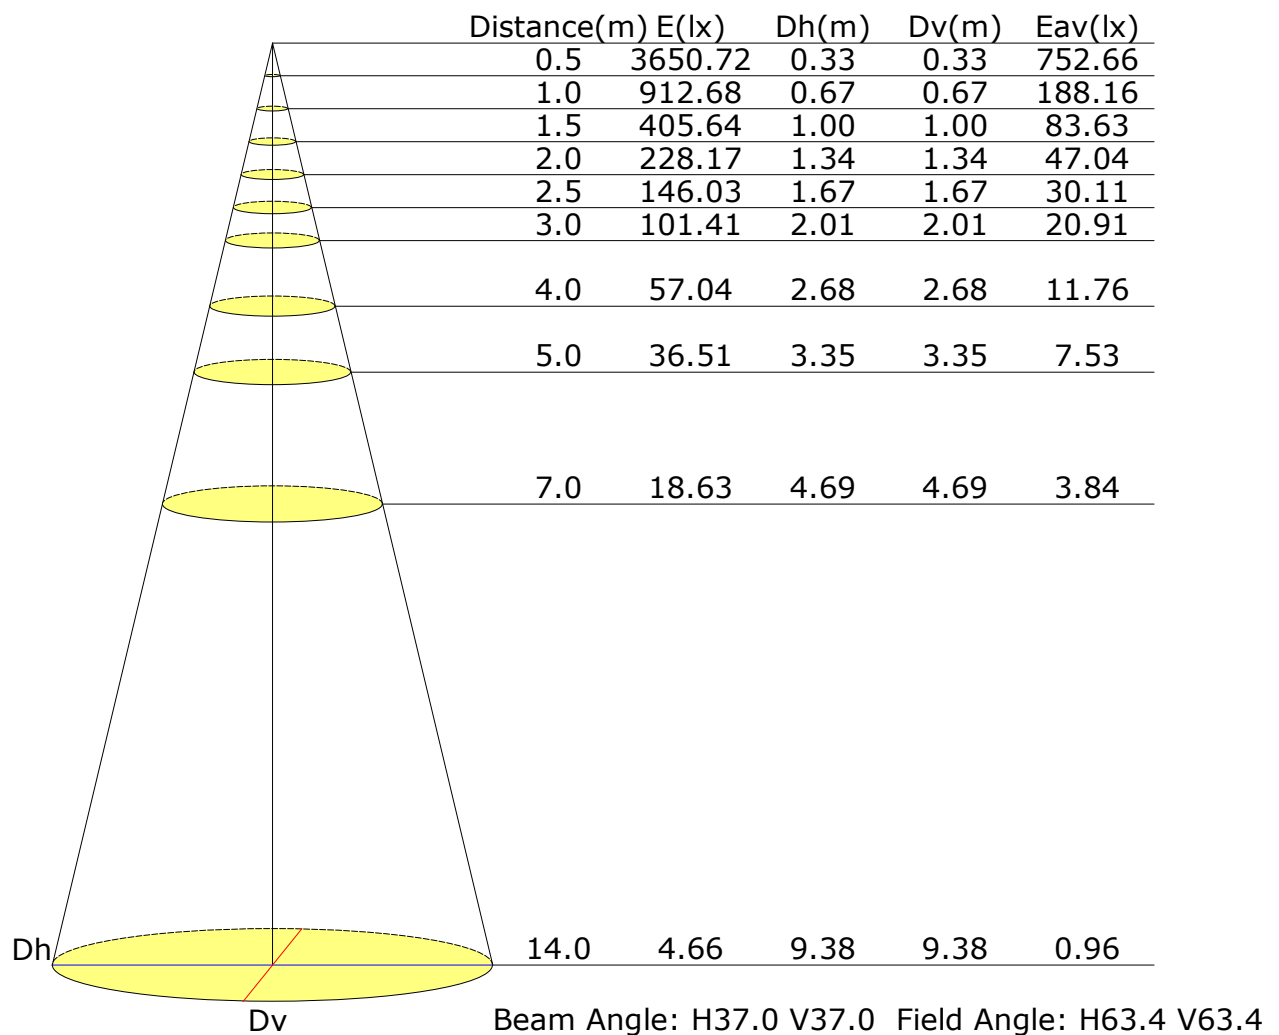

Vertical IsoLux Plot

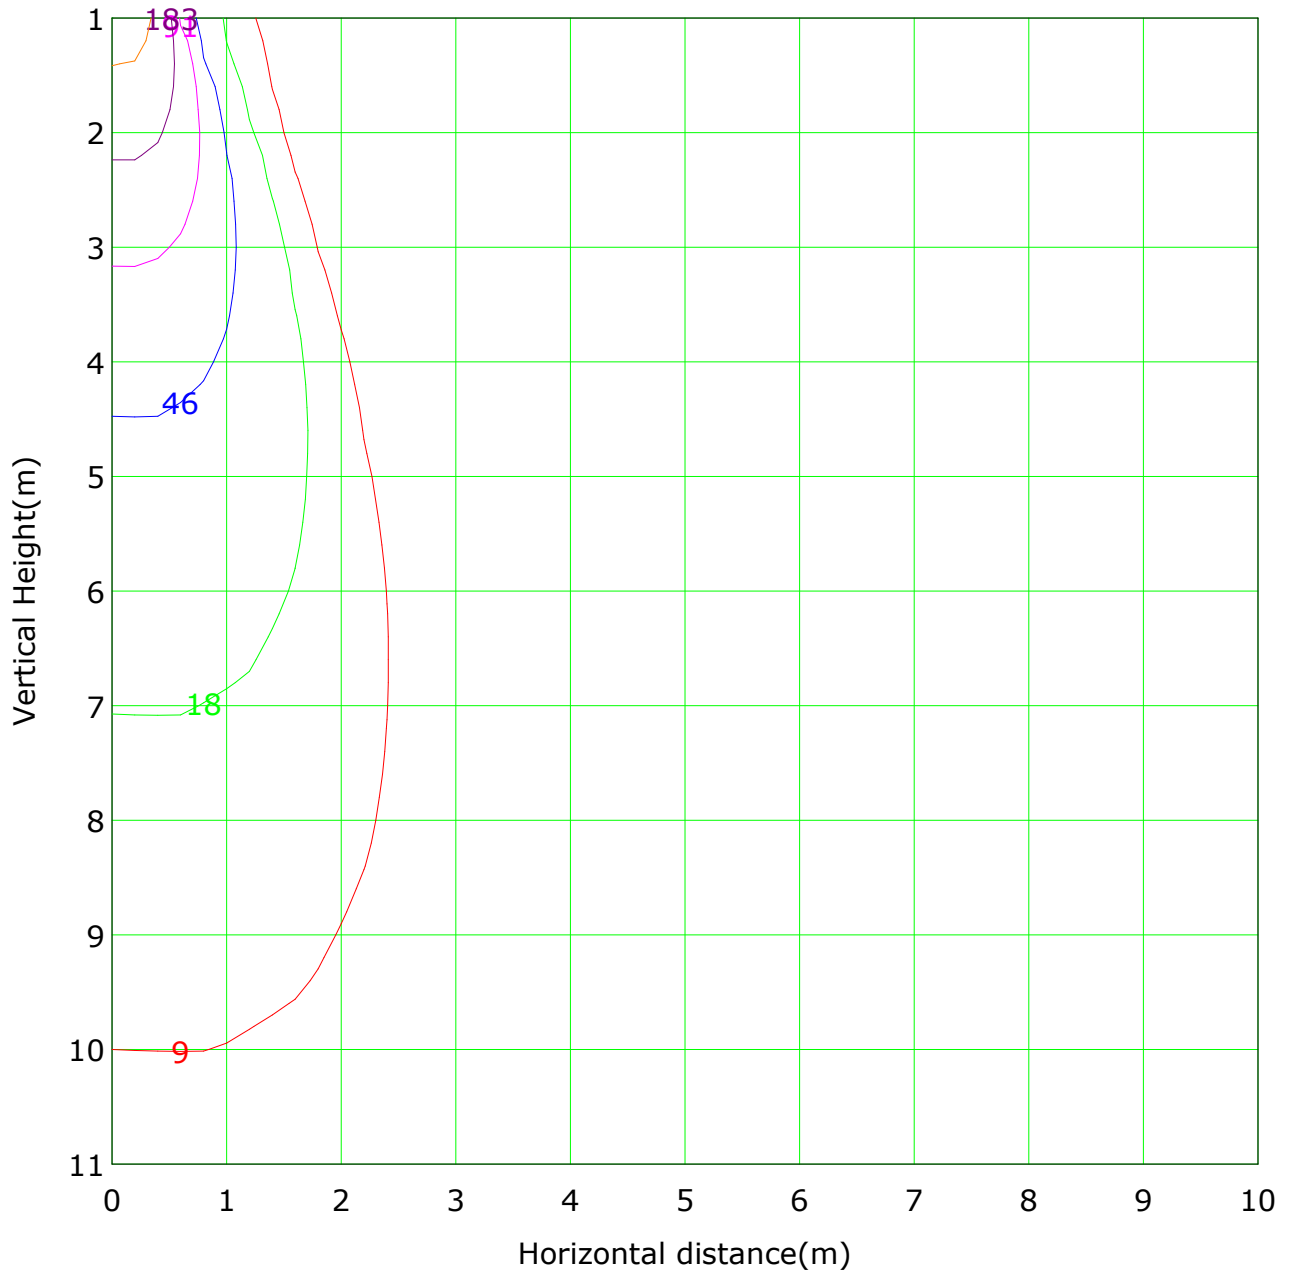


Lowest(m): 1m Highest(m): 11 Max Lux: 913

(1%): 9 lx	(2%): 18 lx
(5%): 46 lx	(10%): 91 lx
(20%): 183 lx	(50%): 456 lx
(100%): 913 lx	

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:5.0
Test Device: CHL-6E
Distance: 3.000 m
Humidity:
Inspector:

The average illuminance effective figure

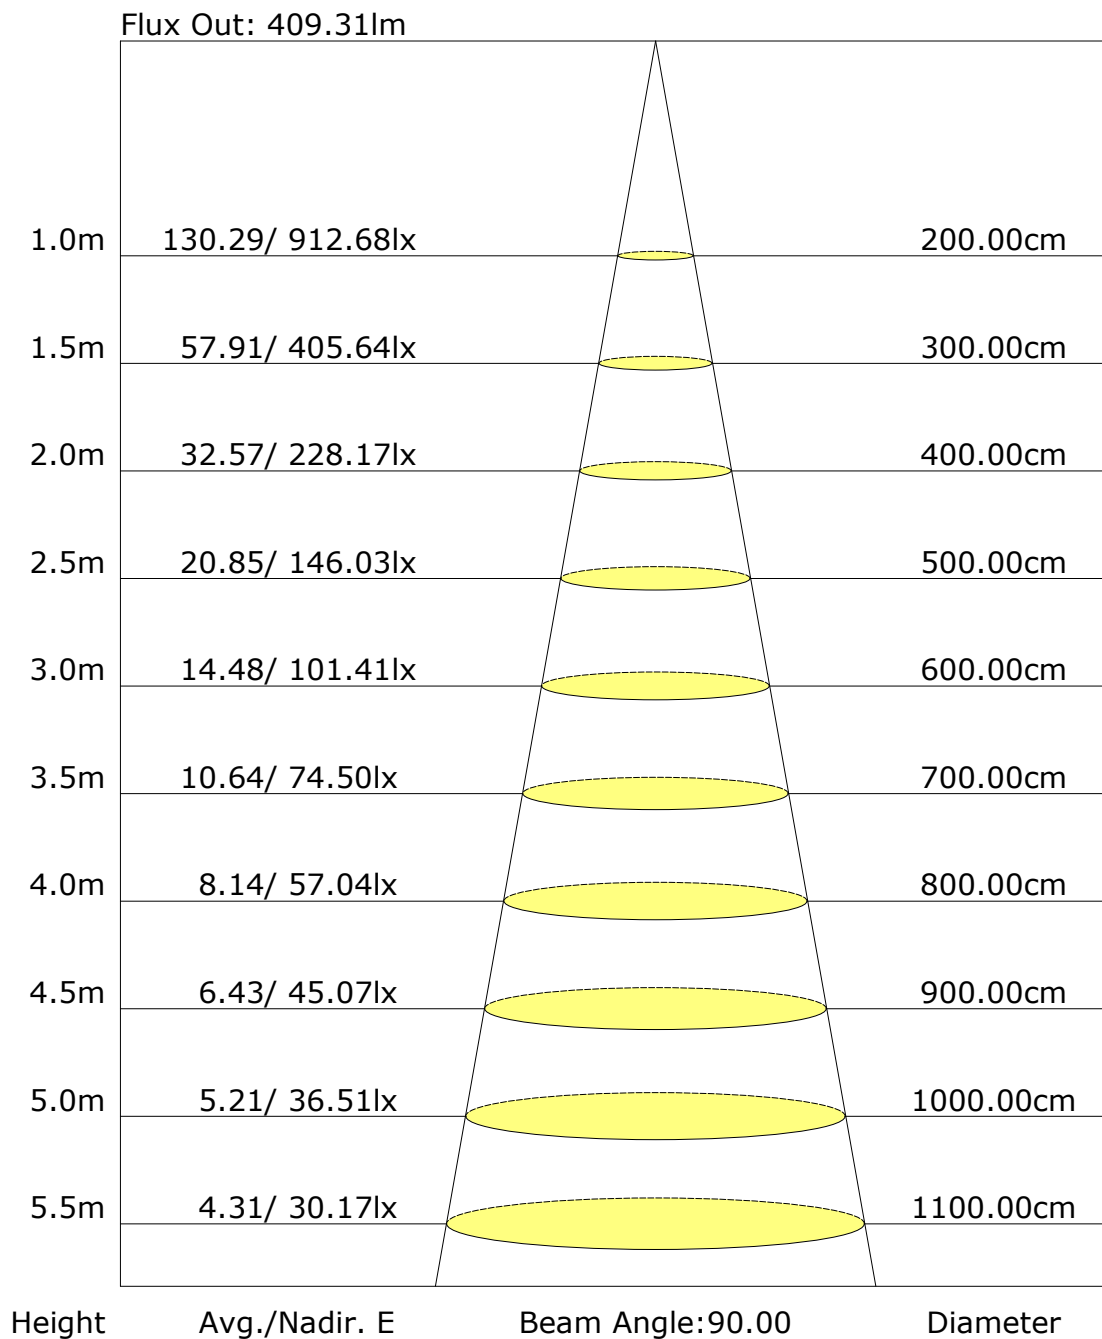

C Plane (°): 0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°): 0.0-90.0: 5.0
Test Device: CHL-6E
Distance: 3.000 m
Humidity:
Inspector:

Zonal Lumen

[illegible]

Inspector:

Candlepower Table

Unit: cd

[illegible]

C Plane (°):0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:5.0

Test Device: CHL-6E

Distance: 3.000 m

Humidity:

Inspector: