

Report No.:

Test Time: 2026-04-11 16:20

Luminaire Property

Luminaire Manufacturer:

Luminaire Description: SOFT55-36D

Luminous Width (mm): -51

Current: 0.060 A

Power Factor: 0.934

Luminous Length (mm): -51

Voltage: 227.3 V

Power: 12.30 W

Photometric Results

CIE Class: Direct

Measurement Flux: 1173 lm

Downward Ratio: 100%

Horizontal Diffuse Angle(50%): H38.6

Vertical Diffuse Angle(50%): V38.6

Luminaire Efficacy Rating (LER): 95.42

Max. Intensity: 2870.38 cd

S/MH(C0/C180): 0.63

Total Rated Lamp Lumens: 1173.0 lm

Efficiency: 100%


Upward Ratio: 0%

Central Intensity: 2870.37 cd


Pos of Max. Intensity: H0 V0

S/MH(C90/C270): 0.63

Picture Of Luminaire



Luminous Intensity Distribution Curve

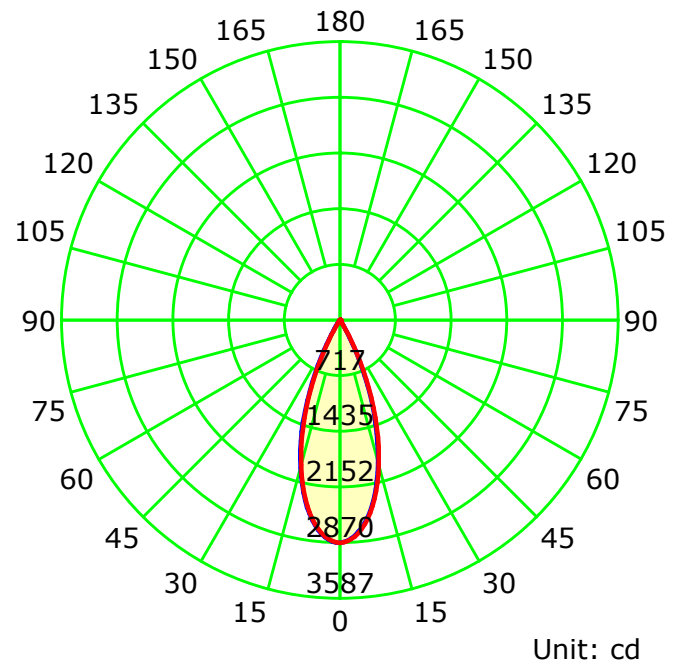

— C0-C180 — C90-C270

C Plane (°):0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0


Test Device: CHL-6E

Distance: 3.010 m

Humidity:

Inspector:


Luminous Intensity Distribution Curve

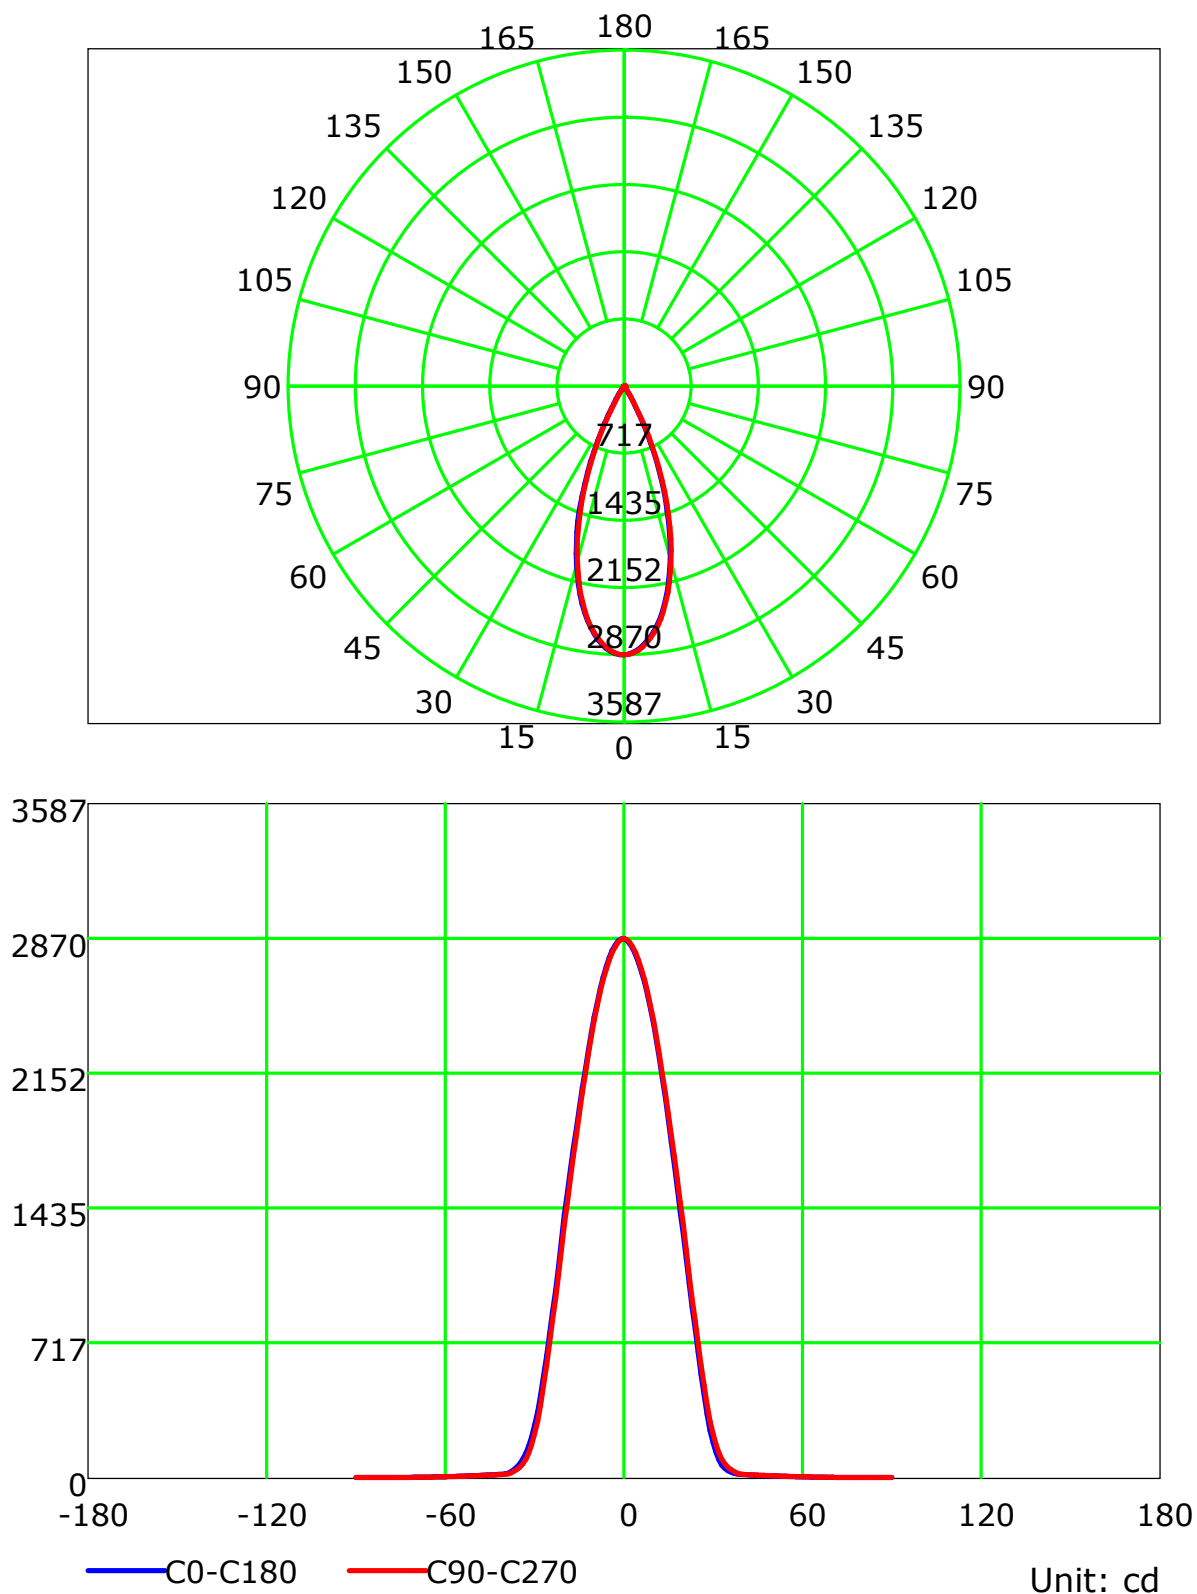

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:


Luminous Intensity Distribution Curve(cd/klm)

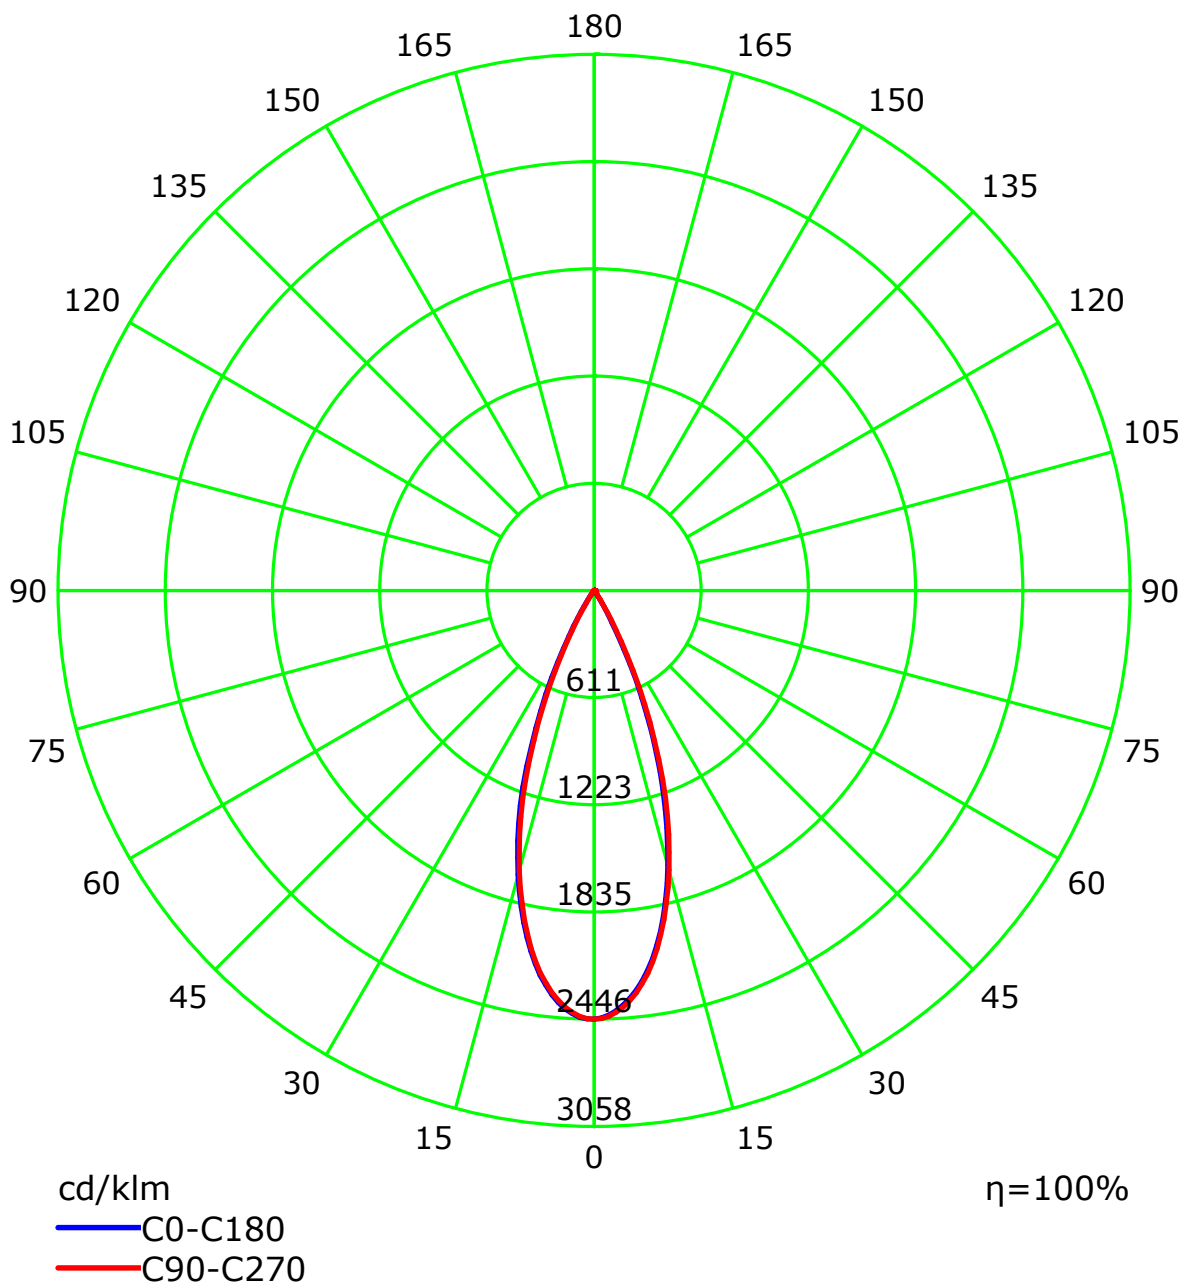

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Isocandela (rectangle)

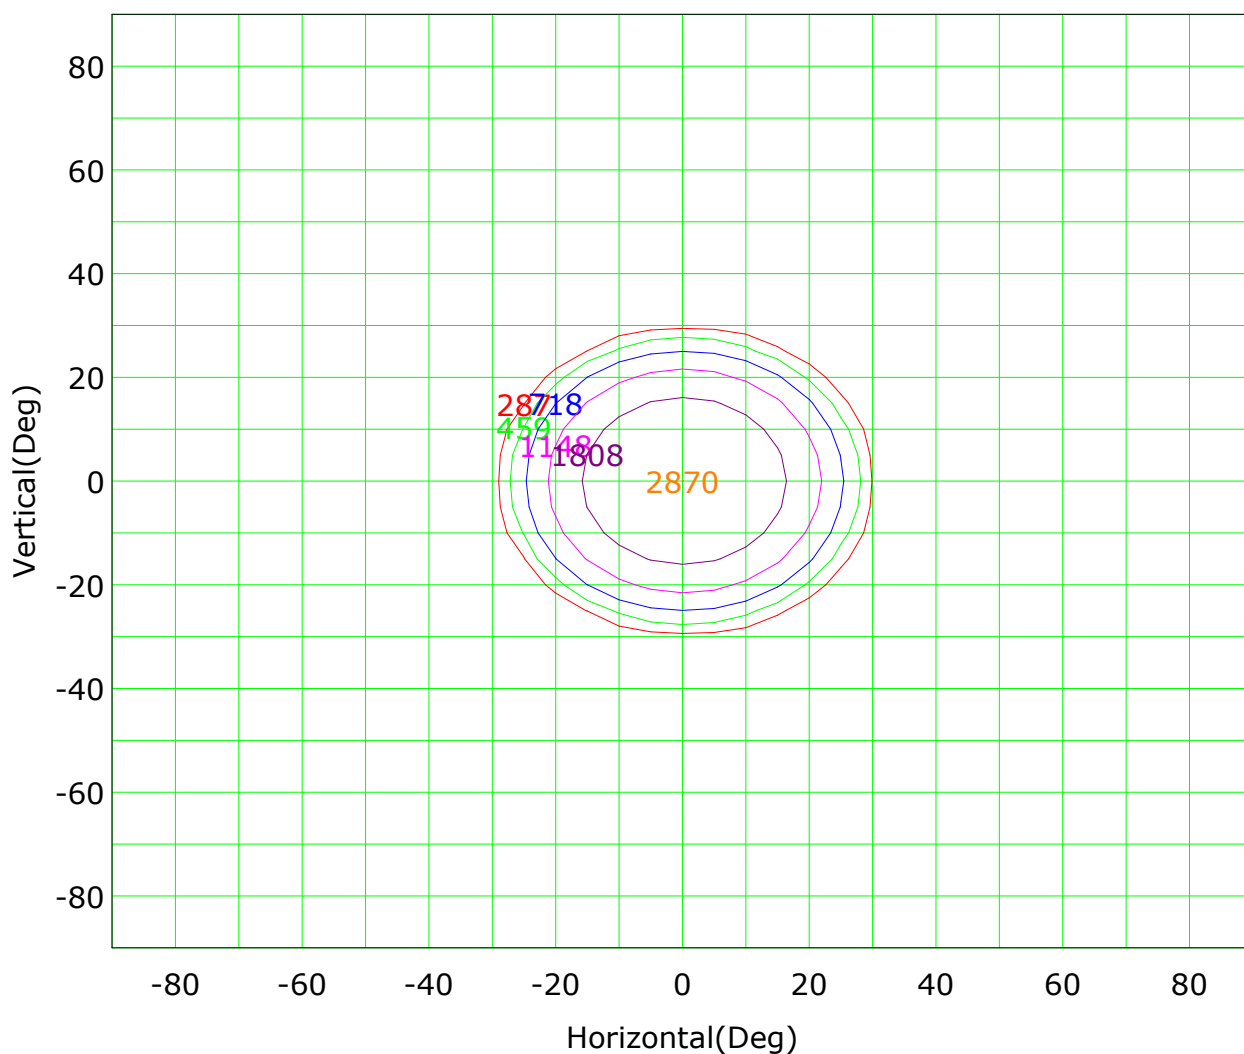

Imax (100%): 2870 cd

(10%): 287 cd	(16%): 459 cd
(25%): 718 cd	(40%): 1148 cd
(63%): 1808 cd	(100%): 2870 cd

C Plane (°):0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0


Test Device: CHL-6E

Distance: 3.010 m

Humidity:

Inspector:

IsoLux Plot

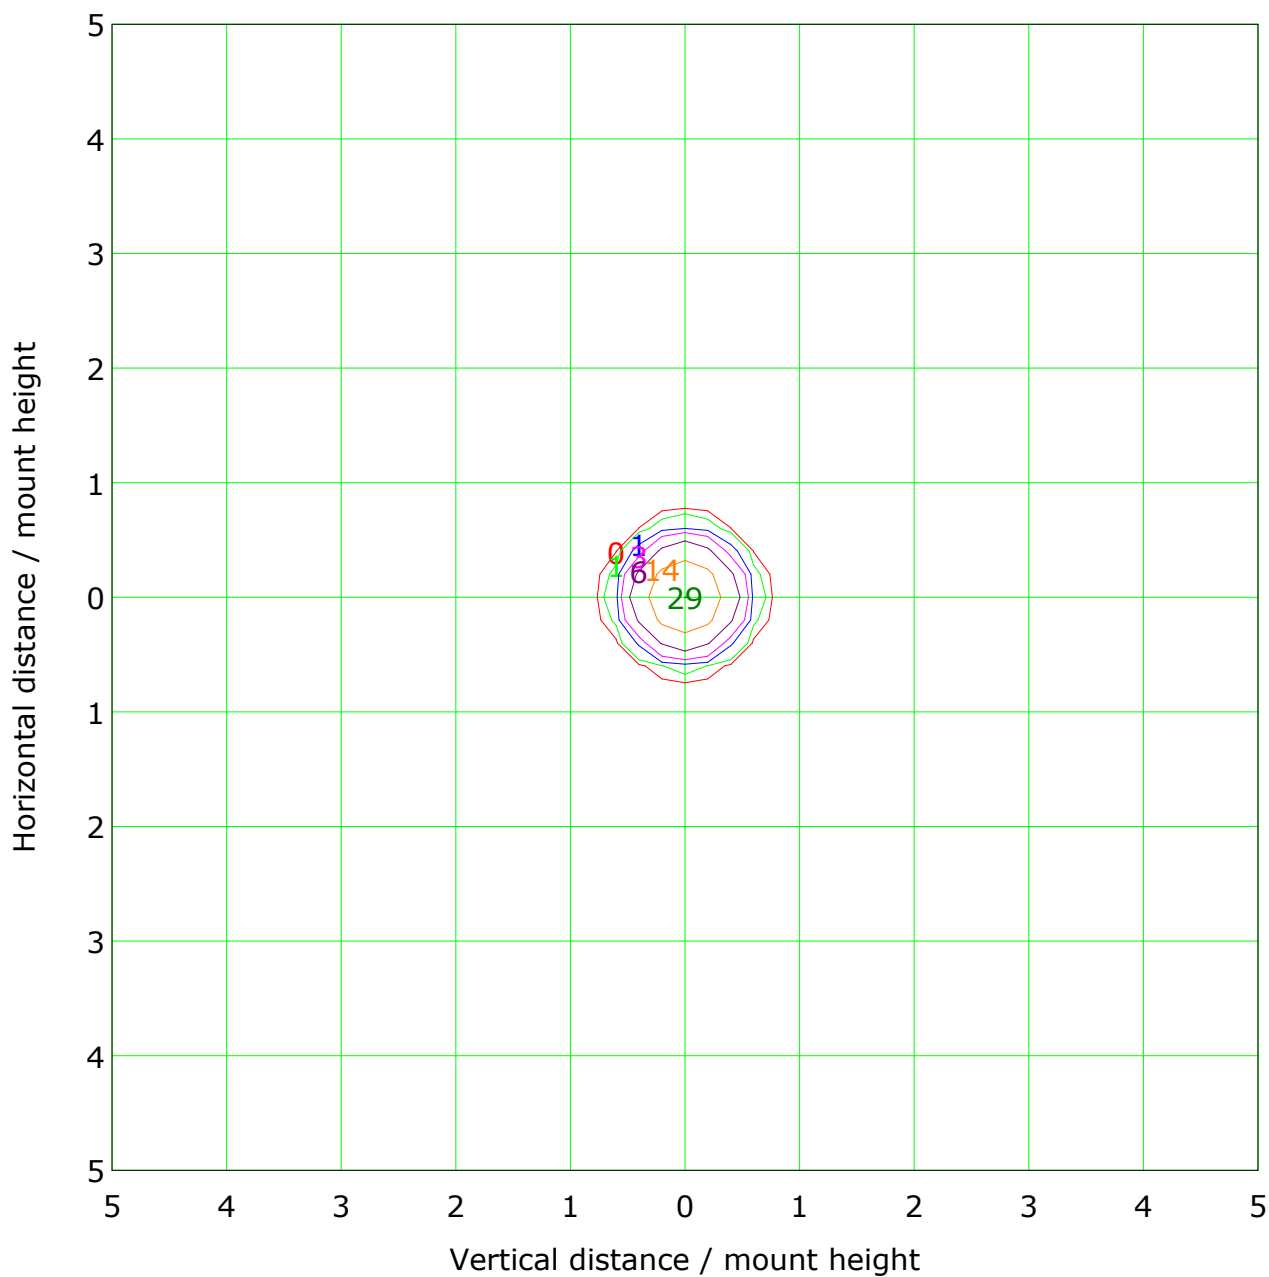


Mounting Height: 10.0m Max Lux(100%): 28.7 lx

(1%): 0.3 lx	(2%): 0.6 lx
(5%): 1.4 lx	(10%): 2.9 lx
(20%): 5.7 lx	(50%): 14.4 lx
(100%): 28.7 lx	

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:


Illuminance at a Distance

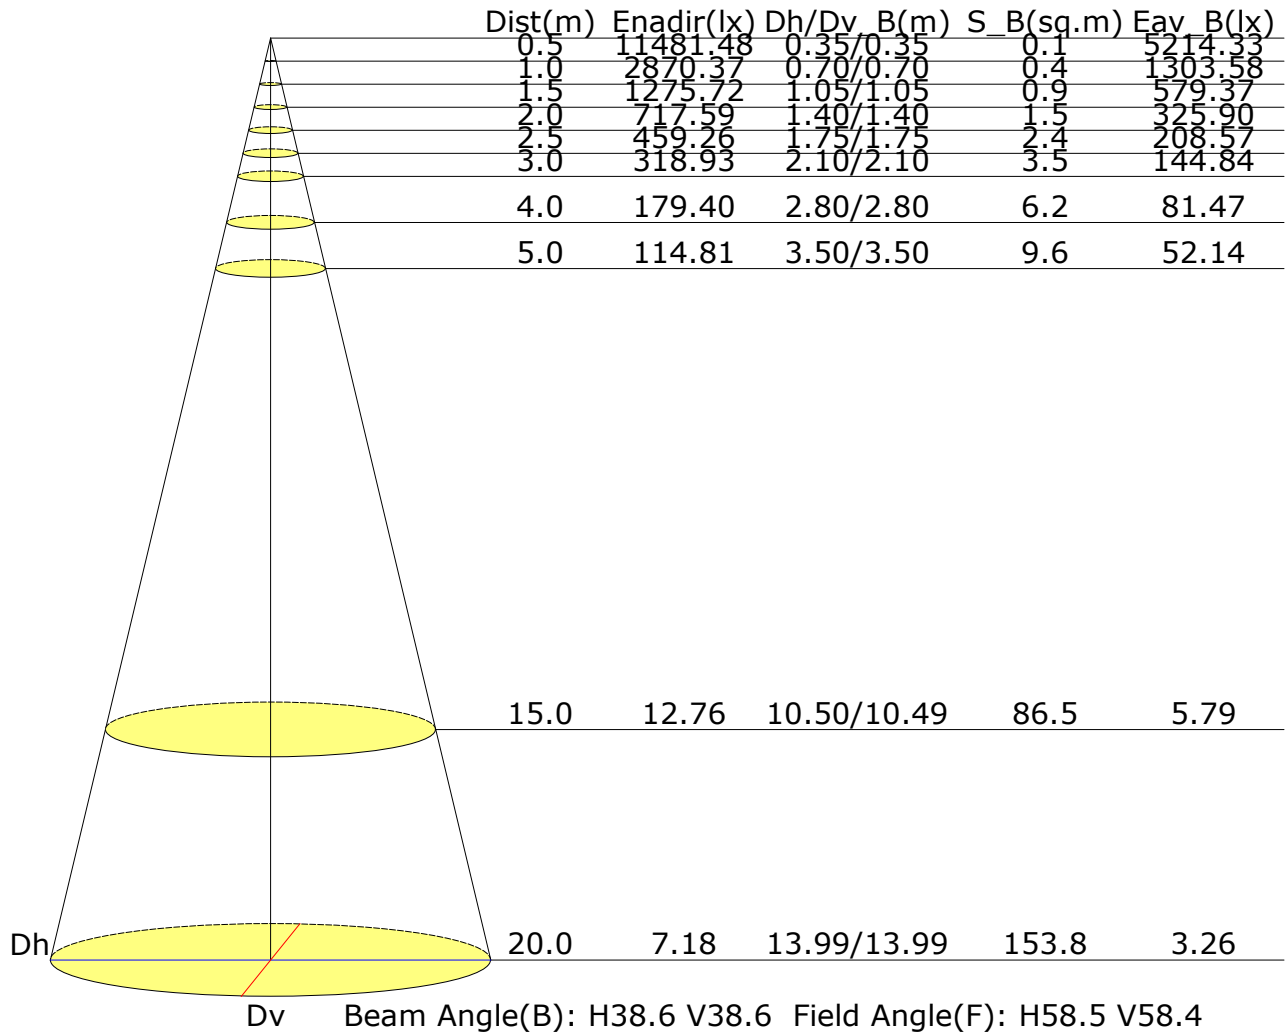

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Vertical IsoLux Plot

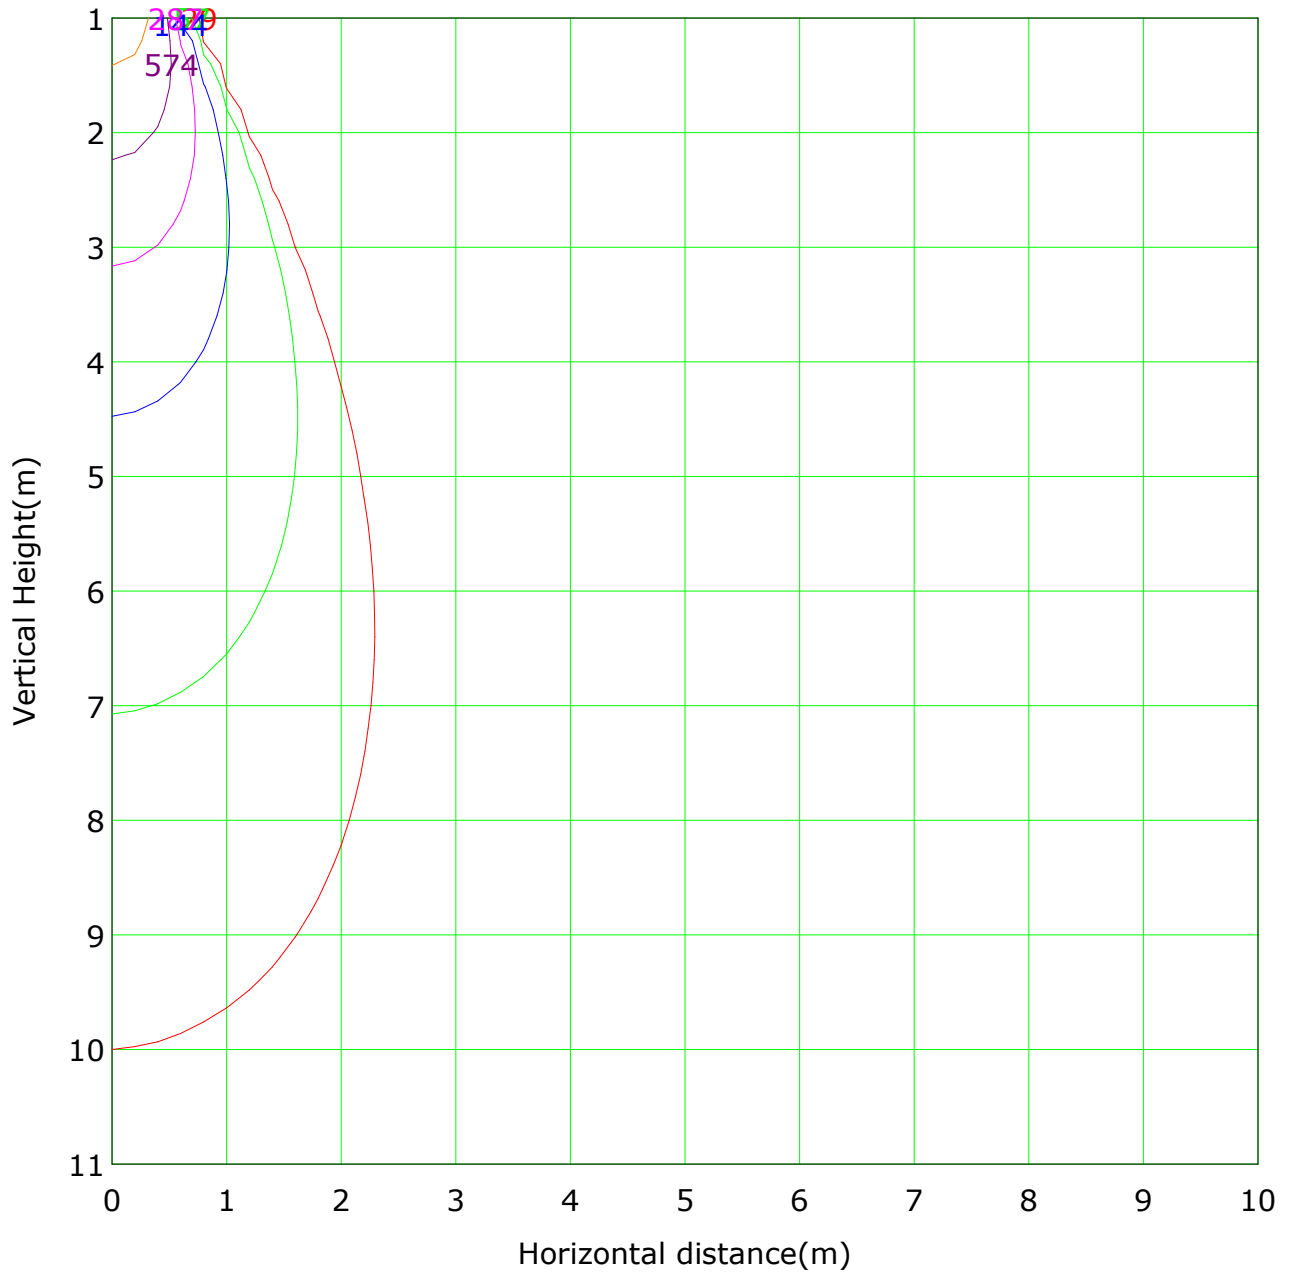


Lowest(m): 1.0m Highest(m): 11.0m Max Lux: 2870.4 lx
— (1%): 28.7 lx — (2%): 57.4 lx
— (5%): 143.5 lx — (10%): 287.0 lx
— (20%): 574.1 lx — (50%): 1435.2 lx
— (100%): 2870.4 lx

C Plane (°): 0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°): 0.0-90.0: 1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

The Average Illuminance Effective Figure

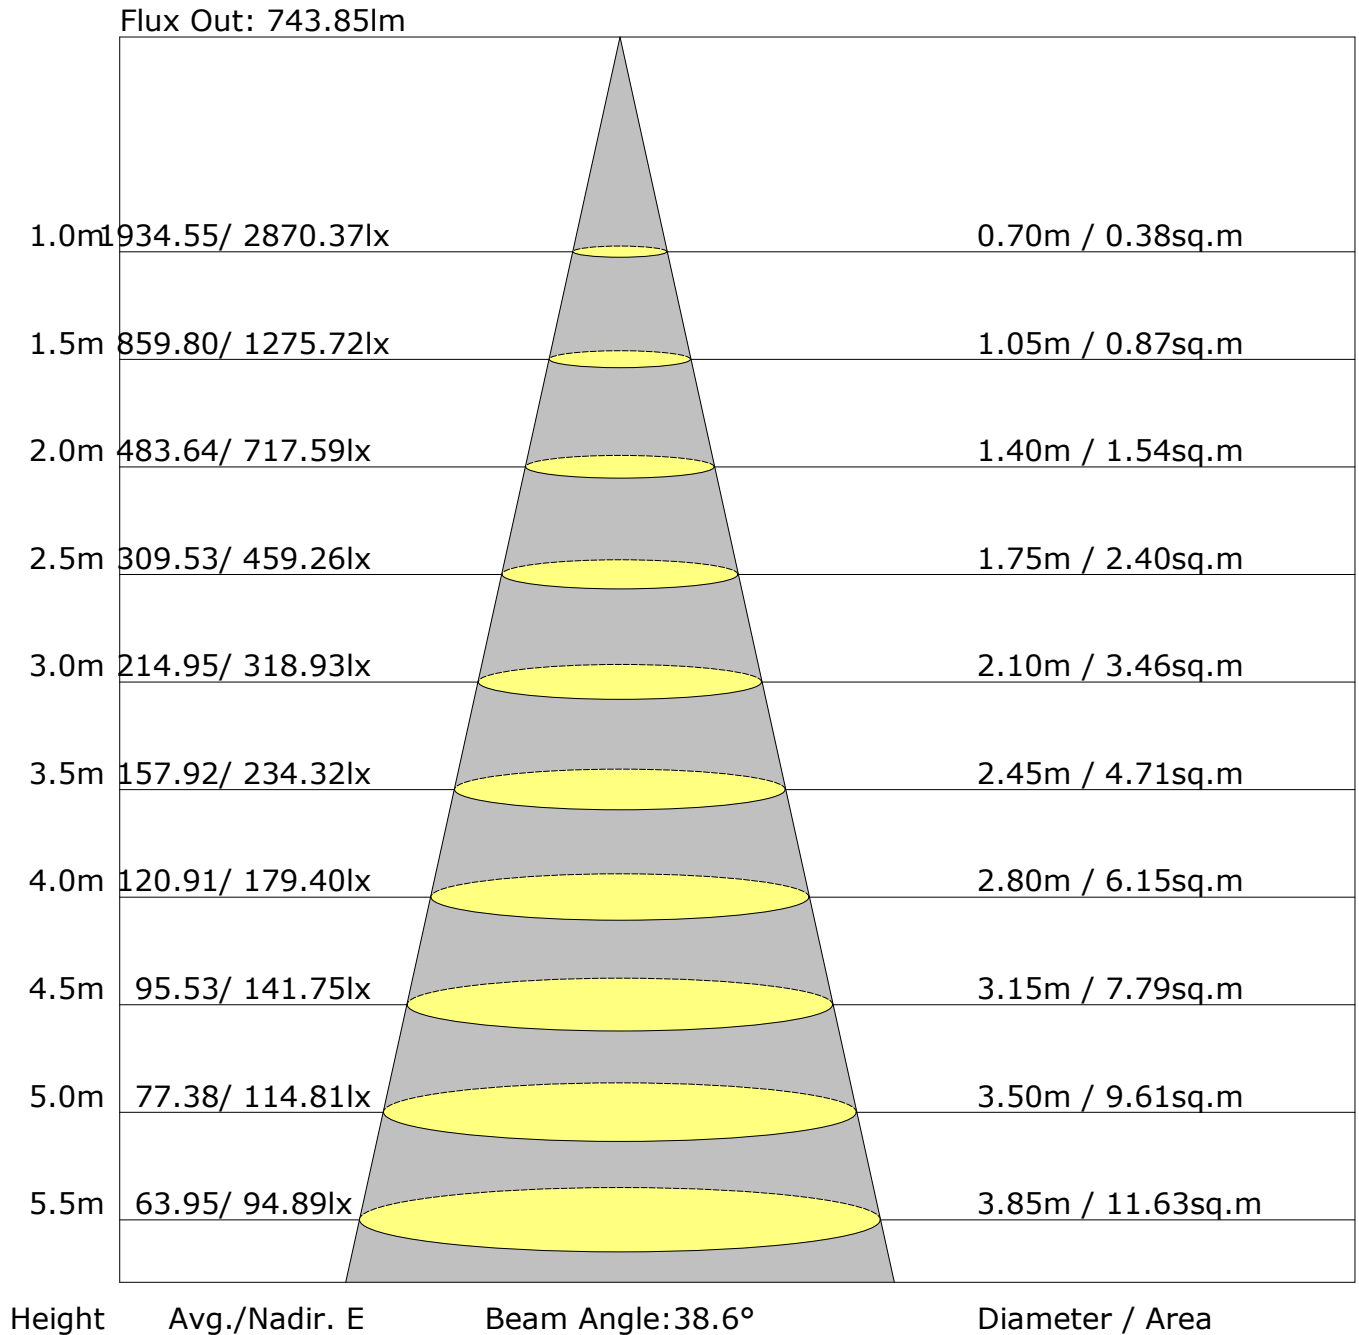

C Plane (°): 0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°): 0.0-90.0: 1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

UGR Table

Reflectance:										
Ceiling (cavity)	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
X=2H Y=2H	9.9	10.6	10.1	10.8	11.0	11.1	11.8	11.4	12.0	12.2
3H	10.0	10.6	10.3	10.8	11.1	11.2	11.8	11.5	12.0	12.3
4H	10.0	10.6	10.3	10.8	11.1	11.2	11.7	11.5	12.0	12.3
6H	10.0	10.5	10.3	10.8	11.1	11.1	11.7	11.4	11.9	12.2
8H	9.9	10.4	10.3	10.7	11.0	11.1	11.6	11.4	11.9	12.2
12H	9.9	10.4	10.2	10.7	11.0	11.0	11.5	11.4	11.9	12.2
X=4H Y=2H	9.9	10.5	10.2	10.7	11.0	11.1	11.6	11.4	11.9	12.2
3H	10.1	10.6	10.4	10.9	11.2	11.2	11.7	11.5	12.0	12.3
4H	10.1	10.5	10.4	10.9	11.2	11.2	11.6	11.5	11.9	12.3
6H	10.0	10.4	10.5	10.8	11.2	11.1	11.5	11.5	11.9	12.3
8H	10.0	10.4	10.4	10.8	11.2	11.1	11.4	11.5	11.8	12.2
12H	10.0	10.3	10.4	10.7	11.1	11.0	11.4	11.5	11.8	12.2
X=8H Y=4H	10.0	10.4	10.4	10.8	11.2	11.1	11.4	11.5	11.8	12.2
6H	10.0	10.3	10.4	10.7	11.2	11.0	11.3	11.5	11.8	12.2
8H	9.9	10.2	10.4	10.7	11.1	11.0	11.3	11.5	11.7	12.2
12H	9.9	10.2	10.4	10.6	11.1	11.0	11.2	11.5	11.7	12.2
X=12H Y=4H	10.0	10.3	10.4	10.7	11.1	11.0	11.4	11.5	11.8	12.2
6H	9.9	10.2	10.4	10.6	11.1	11.0	11.2	11.5	11.7	12.2
8H	9.9	10.1	10.4	10.6	11.1	11.0	11.2	11.4	11.6	12.1
Variations with the observer position at spacings:										
S=1.0H	+4.4/-2.9					+5.1/-3.5				
S=1.5H	+6.9/-4.3					+7.7/-5.0				
S=2.0H	+8.9/-5.5					+9.7/-6.3				

Calculate in accordance with CIE Pub.117. The table is revised with 1173lm ($8\log(F/F_0) = 0.6$).

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

FLUX DISTRIBUTION TABLE BASED ON THE IESNA LUMINAIRE CLASSIFICATION SYSTEM

	ZONE	LUMENS	% LAMP LUMENS
	FORWARD LIGHT	574	49.0
	FL (0°-30°)	544	46.4
	FM (30°-60°)	28	2.4
	FH (60°-80°)	2	0.2
	FVH (80°-90°)	0	0.0
	BACK LIGHT	599	51.0
	BL (0°-30°)	561	47.9
	BM (30°-60°)	35	3.0
	BH (60°-80°)	2	0.2
	BVH (80°-90°)	0	0.0
	UP LIGHT	0	0.0
	UL (90°-100°)	0	0.0
	UH (100°-180°)	0	0.0
	TRAPPED LIGHT	NA	NA

BUG(Backlight,Uplight,Glare) Rating Base On TM-15-07	
Asymmetrical Luminaire Types (Type I,II,III,IV)	B2 U0 G0
Quadrilateral Symmetrical Luminaire Types (Type V,Area Light)	B2 U0 G0

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Zonal Lumen

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
0.0-1.0	2867.5	2.7	2.7	0.23	0.23
1.0-2.0	2857.7	8.2	10.9	0.70	0.93
2.0-3.0	2838.8	13.6	24.5	1.16	2.09
3.0-4.0	2810.8	18.8	43.3	1.60	3.69
4.0-5.0	2774.2	23.9	67.2	2.03	5.73
5.0-6.0	2730.0	28.7	95.9	2.45	8.18
6.0-7.0	2677.7	33.2	129.1	2.83	11.01
7.0-8.0	2617.5	37.5	166.6	3.19	14.20
8.0-9.0	2549.7	41.3	207.9	3.52	17.73
9.0-10.0	2473.3	44.8	252.7	3.82	21.54
10.0-11.0	2388.8	47.7	300.4	4.07	25.61
11.0-12.0	2298.3	50.2	350.7	4.28	29.90
12.0-13.0	2201.3	52.2	402.9	4.45	34.35
13.0-14.0	2098.9	53.7	456.7	4.58	38.93
14.0-15.0	1992.3	54.7	511.4	4.66	43.59
15.0-16.0	1880.9	55.1	566.5	4.70	48.29
16.0-17.0	1766.1	55.0	621.5	4.69	52.98
17.0-18.0	1649.2	54.4	675.9	4.64	57.62
18.0-19.0	1529.9	53.2	729.1	4.54	62.16
19.0-20.0	1407.7	51.5	780.6	4.39	66.55
20.0-21.0	1279.7	49.1	829.8	4.19	70.74
21.0-22.0	1146.7	46.1	875.9	3.93	74.67
22.0-23.0	1017.2	42.7	918.6	3.64	78.31
23.0-24.0	895.1	39.1	957.7	3.34	81.64
24.0-25.0	776.6	35.3	993.0	3.01	84.65
25.0-26.0	658.8	31.1	1024.1	2.65	87.31
26.0-27.0	544.9	26.7	1050.8	2.27	89.58
27.0-28.0	438.9	22.2	1073.0	1.89	91.47
28.0-29.0	345.2	18.1	1091.1	1.54	93.01
29.0-30.0	267.0	14.4	1105.5	1.23	94.24
30.0-31.0	203.8	11.3	1116.8	0.97	95.21
31.0-32.0	153.6	8.8	1125.6	0.75	95.96
32.0-33.0	114.6	6.7	1132.4	0.58	96.53
33.0-34.0	85.4	5.2	1137.6	0.44	96.97
34.0-35.0	64.4	4.0	1141.5	0.34	97.32
35.0-36.0	49.2	3.1	1144.7	0.27	97.58

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Zonal Lumen (Continue 1)

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
36.0-37.0	37.6	2.5	1147.1	0.21	97.79
37.0-38.0	28.9	1.9	1149.1	0.16	97.96
38.0-39.0	22.9	1.6	1150.6	0.13	98.09
39.0-40.0	19.3	1.3	1152.0	0.11	98.20
40.0-41.0	17.6	1.3	1153.2	0.11	98.31
41.0-42.0	16.5	1.2	1154.4	0.10	98.41
42.0-43.0	15.5	1.1	1155.6	0.10	98.51
43.0-44.0	14.6	1.1	1156.7	0.09	98.60
44.0-45.0	13.7	1.1	1157.7	0.09	98.69
45.0-46.0	13.0	1.0	1158.7	0.09	98.78
46.0-47.0	12.3	1.0	1159.7	0.08	98.86
47.0-48.0	11.6	0.9	1160.7	0.08	98.94
48.0-49.0	10.9	0.9	1161.6	0.08	99.02
49.0-50.0	10.3	0.9	1162.4	0.07	99.09
50.0-51.0	9.6	0.8	1163.2	0.07	99.16
51.0-52.0	9.1	0.8	1164.0	0.07	99.23
52.0-53.0	8.6	0.8	1164.8	0.06	99.29
53.0-54.0	8.0	0.7	1165.5	0.06	99.35
54.0-55.0	7.4	0.7	1166.1	0.06	99.41
55.0-56.0	6.9	0.6	1166.8	0.05	99.46
56.0-57.0	6.4	0.6	1167.3	0.05	99.51
57.0-58.0	5.8	0.5	1167.9	0.05	99.56
58.0-59.0	5.4	0.5	1168.4	0.04	99.60
59.0-60.0	5.0	0.5	1168.9	0.04	99.64
60.0-61.0	4.5	0.4	1169.3	0.04	99.68
61.0-62.0	4.0	0.4	1169.7	0.03	99.71
62.0-63.0	3.7	0.4	1170.0	0.03	99.74
63.0-64.0	3.4	0.3	1170.4	0.03	99.77
64.0-65.0	3.1	0.3	1170.7	0.03	99.80
65.0-66.0	2.8	0.3	1171.0	0.02	99.82
66.0-67.0	2.5	0.3	1171.2	0.02	99.84
67.0-68.0	2.3	0.2	1171.4	0.02	99.86
68.0-69.0	1.9	0.2	1171.6	0.02	99.88
69.0-70.0	1.8	0.2	1171.8	0.02	99.90
70.0-71.0	1.8	0.2	1172.0	0.02	99.91
71.0-72.0	1.5	0.2	1172.2	0.01	99.93

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Candlepower Table

Unit: cd

G\C	C0.0	C180.0								
G0.0	2870.4	2870.4								
G1.0	2860.8	2868.4								
G2.0	2844.3	2857.3								
G3.0	2818.4	2835.4								
G4.0	2782.8	2806.6								
G5.0	2739.4	2768.0								
G6.0	2691.7	2720.8								
G7.0	2635.3	2663.0								
G8.0	2570.2	2601.3								
G9.0	2497.9	2529.4								
G10.0	2414.7	2451.2								
G11.0	2324.8	2364.7								
G12.0	2229.6	2274.3								
G13.0	2125.8	2175.5								
G14.0	2019.1	2075.1								
G15.0	1904.8	1970.3								
G16.0	1786.7	1861.9								
G17.0	1663.4	1752.4								
G18.0	1540.9	1640.0								
G19.0	1415.5	1523.0								
G20.0	1290.9	1401.3								
G21.0	1163.4	1263.1								
G22.0	1035.4	1125.0								
G23.0	909.8	998.6								
G24.0	789.7	882.2								
G25.0	669.2	765.4								
G26.0	550.4	650.4								
G27.0	438.0	540.8								
G28.0	336.8	439.9								
G29.0	251.6	352.5								
G30.0	185.1	278.8								
G31.0	133.6	217.6								
G32.0	94.0	169.1								
G33.0	65.5	129.7								
G34.0	48.0	98.2								
G35.0	36.9	74.3								
G36.0	29.0	56.6								

C Plane (°):0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0

Test Device: CHL-6E

Distance: 3.010 m

Humidity:

Inspector:

Candlepower Table (Continue 1)

Unit: cd

G\C	C0.0	C180.0								
G37.0	23.3	41.7								
G38.0	19.7	31.1								
G39.0	18.2	22.7								
G40.0	16.8	19.5								
G41.0	15.6	18.3								
G42.0	14.7	17.3								
G43.0	13.8	16.2								
G44.0	13.1	15.2								
G45.0	12.2	14.4								
G46.0	11.6	13.8								
G47.0	10.8	13.1								
G48.0	10.2	12.2								
G49.0	9.8	11.6								
G50.0	9.2	10.8								
G51.0	8.6	10.1								
G52.0	8.1	9.6								
G53.0	7.7	9.2								
G54.0	6.9	8.4								
G55.0	6.6	7.8								
G56.0	6.0	7.4								
G57.0	5.4	6.8								
G58.0	5.1	6.0								
G59.0	4.8	5.7								
G60.0	4.2	5.1								
G61.0	3.9	4.8								
G62.0	3.5	4.1								
G63.0	3.3	3.9								
G64.0	3.0	3.6								
G65.0	2.5	3.3								
G66.0	2.4	2.8								
G67.0	2.3	2.7								
G68.0	2.0	2.3								
G69.0	1.6	2.0								
G70.0	1.8	2.0								
G71.0	1.5	1.8								
G72.0	1.2	1.4								
G73.0	1.2	1.4								

C Plane (°):0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0

Test Device: CHL-6E

Distance: 3.010 m

Humidity:

Inspector:

Unit: cd

Inspector: