

Report No.:

Test Time: 2026-06-12 17:08

## Luminaire Property

Luminaire Manufacturer:

Luminous Length (mm): -475

Voltage: 227.1 V

Power: 11.00 W

Luminous Width (mm): -10

Current: 0.052 A

Power Factor: 0.925

## Photometric Results

CIE Class: Direct

Measurement Flux: 1285.3 lm

Downward Ratio: 100%

Horizontal Diffuse Angle(50%): H44.5

Vertical Diffuse Angle(50%): V44.5

Luminaire Efficacy Rating (LER): 116.89

Max. Intensity: 2164.88 cd

S/MH(C0/C180): 0.72

Total Rated Lamp Lumens: 1285.3 lm

Efficiency: 100%


Upward Ratio: 0%

Central Intensity: 2164.87 cd


Pos of Max. Intensity: H0 V0

S/MH(C90/C270): 0.72

Picture Of Luminaire



Luminous Intensity Distribution Curve

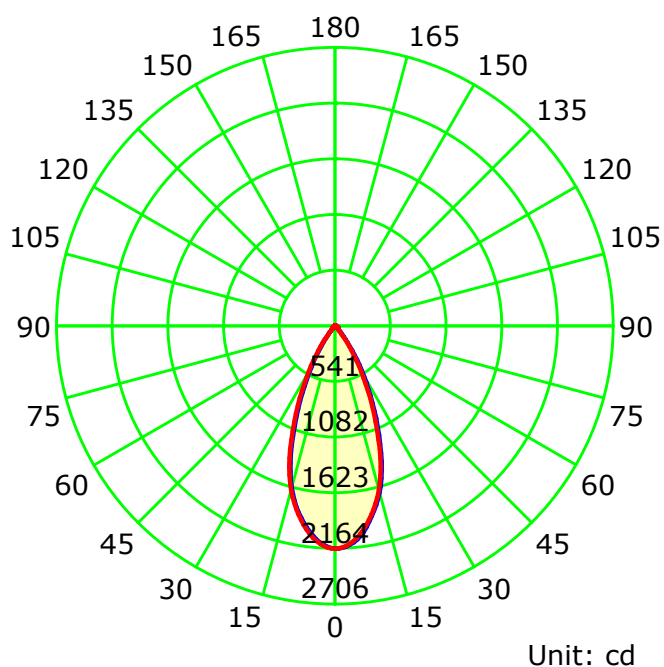

— C0-C180 — C90-C270

C Plane (°):0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0


Test Device: CHL-6E

Distance: 3.010 m

Humidity:

Inspector:


## Luminous Intensity Distribution Curve

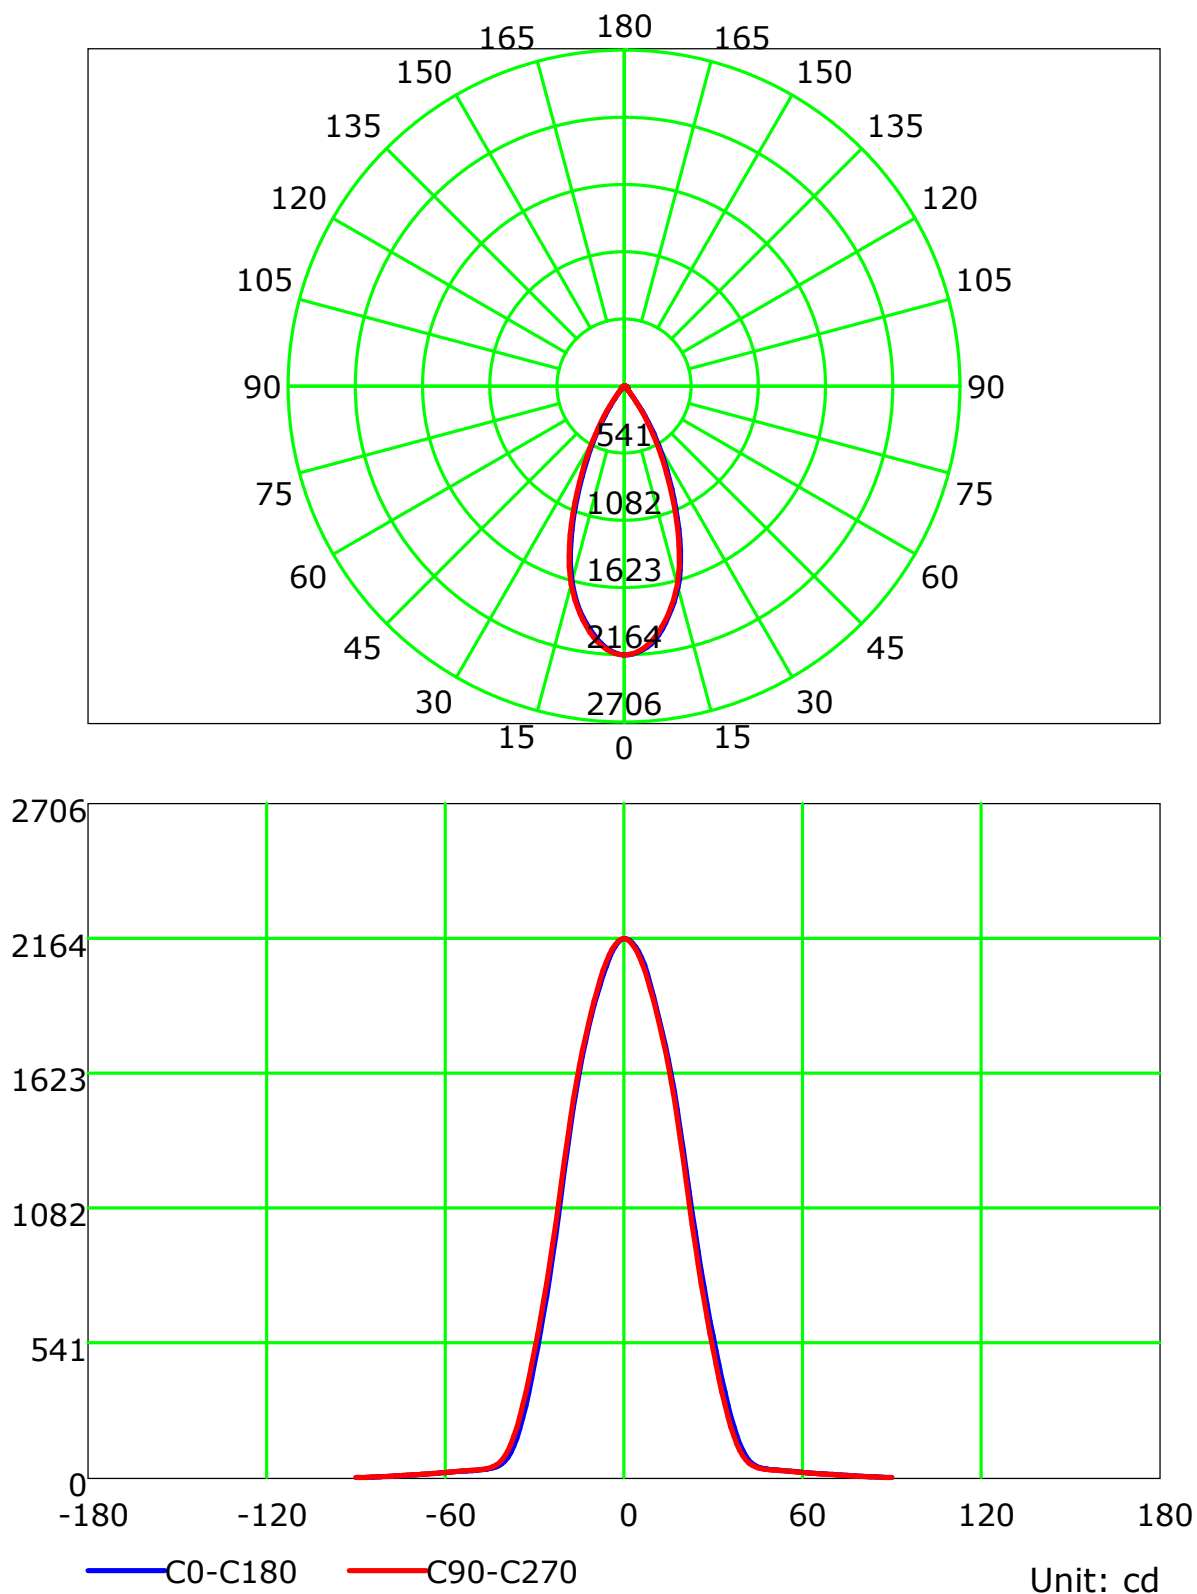


C Plane (°):0.0-180.0: 180.0  
Test Lab:  
Test Type: TYPE C  
Temperature:  
Operator:

Gamma Plane (°):0.0-90.0:1.0  
Test Device: CHL-6E  
Distance: 3.010 m  
Humidity:  
Inspector:

## Luminous Intensity Distribution Curve(cd/klm)

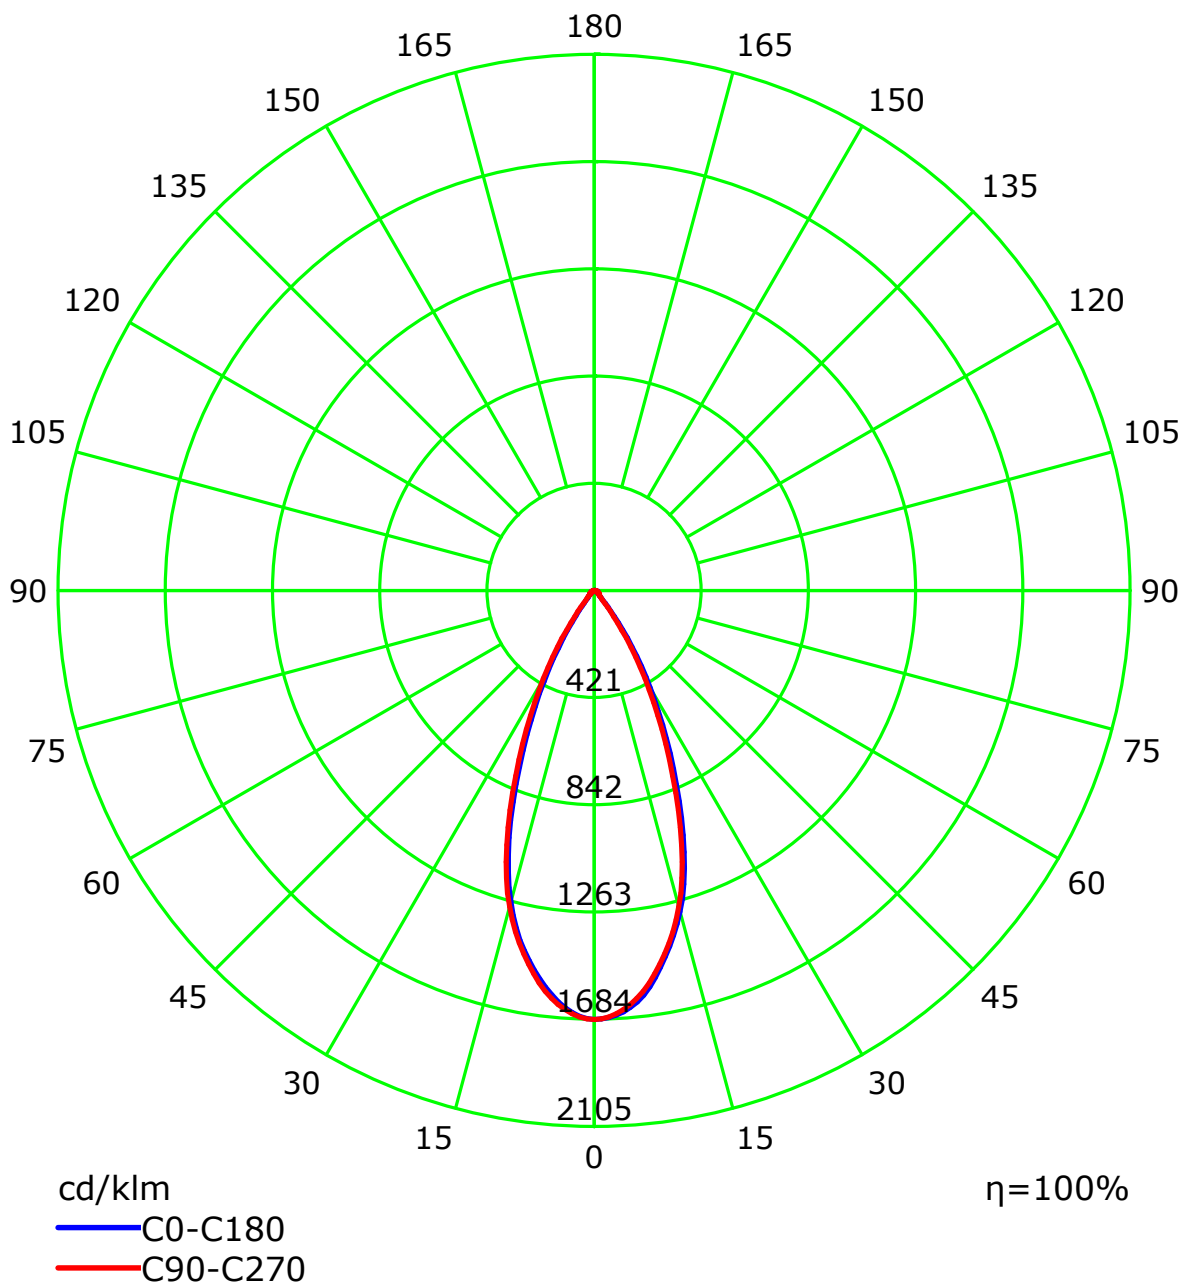

## Isocandela (rectangle)

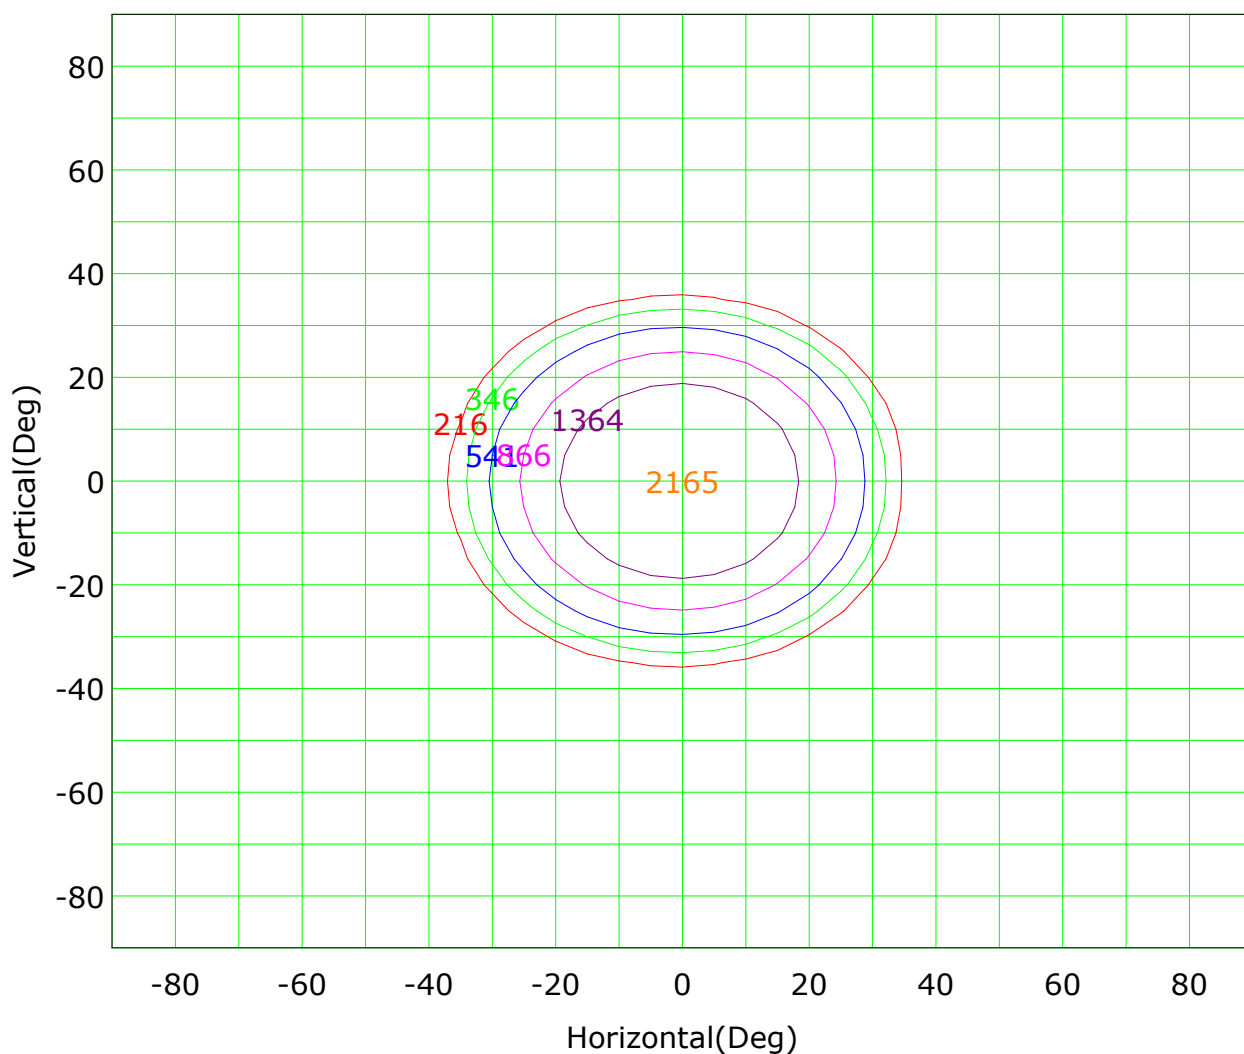

I<sub>max</sub> (100%): 2165 cd

|         |         |         |         |
|---------|---------|---------|---------|
| ( 10%): | 216 cd  | ( 16%): | 346 cd  |
| ( 25%): | 541 cd  | ( 40%): | 866 cd  |
| ( 63%): | 1364 cd | (100%): | 2165 cd |

C Plane (°):0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0


Test Device: CHL-6E

Distance: 3.010 m

Humidity:

Inspector:

## IsoLux Plot

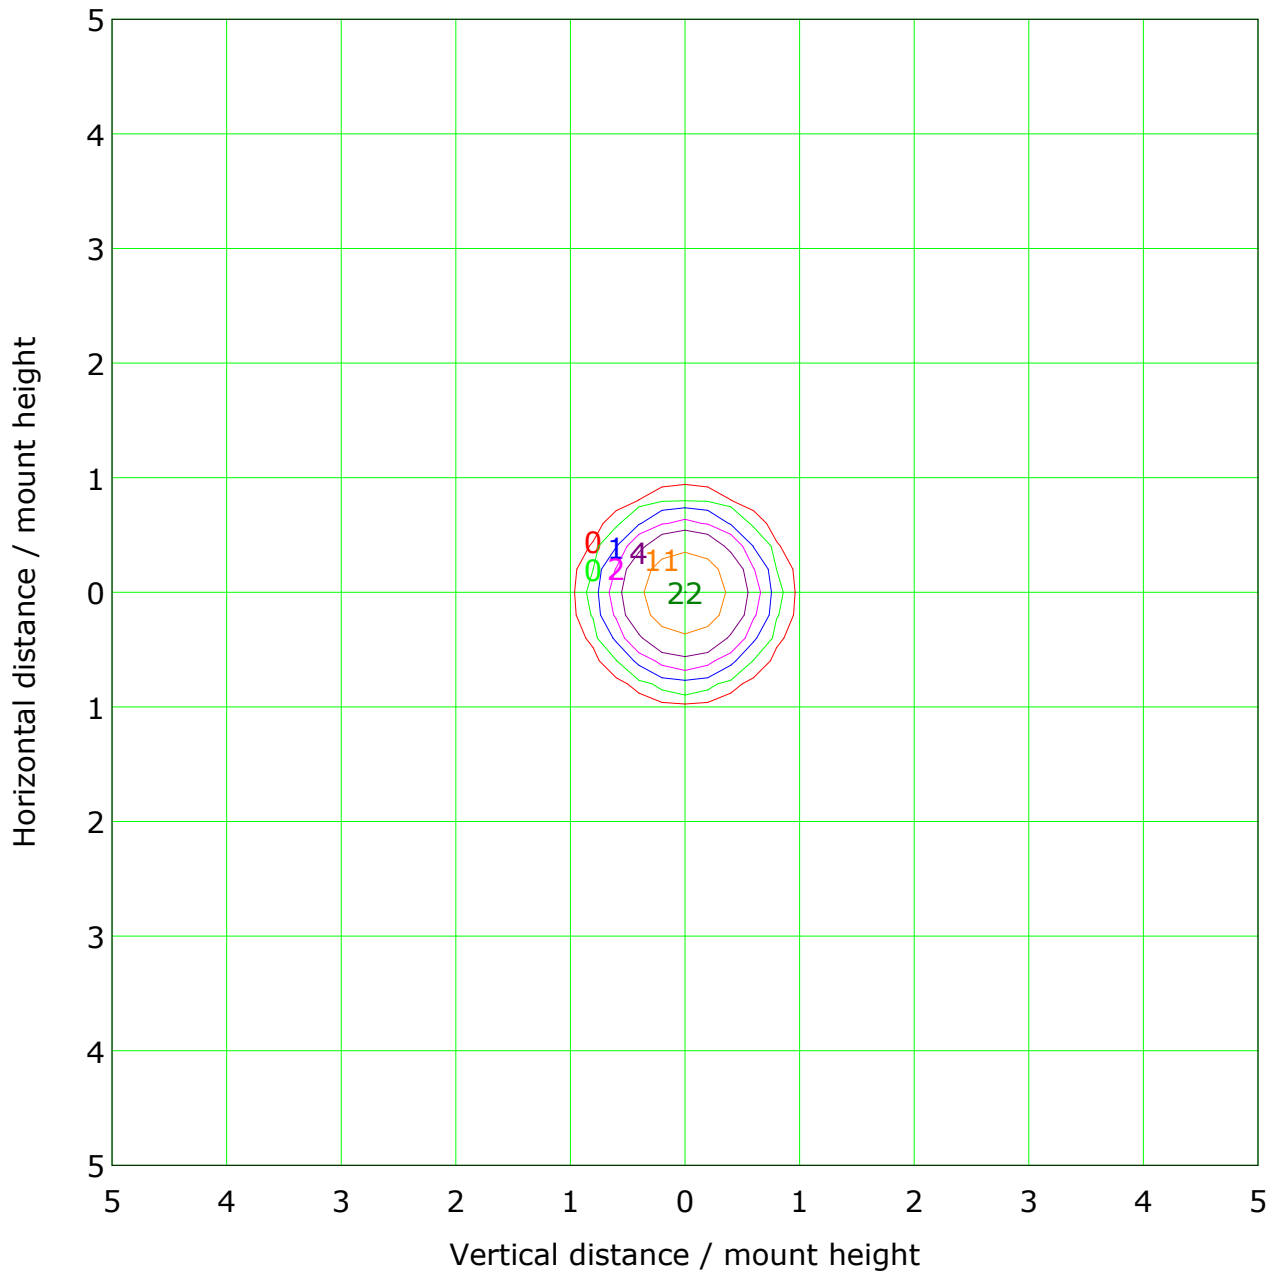


Mounting Height: 10.0m    Max Lux(100%): 21.6 lx

|                 |                 |
|-----------------|-----------------|
| ( 1%): 0.2 lx   | ( 2%): 0.4 lx   |
| ( 5%): 1.1 lx   | ( 10%): 2.2 lx  |
| ( 20%): 4.3 lx  | ( 50%): 10.8 lx |
| (100%): 21.6 lx |                 |


C Plane (°):0.0-180.0: 180.0  
Test Lab:  
Test Type: TYPE C  
Temperature:  
Operator:

Gamma Plane (°):0.0-90.0:1.0  
Test Device: CHL-6E  
Distance: 3.010 m  
Humidity:  
Inspector:

## Illuminance at a Distance

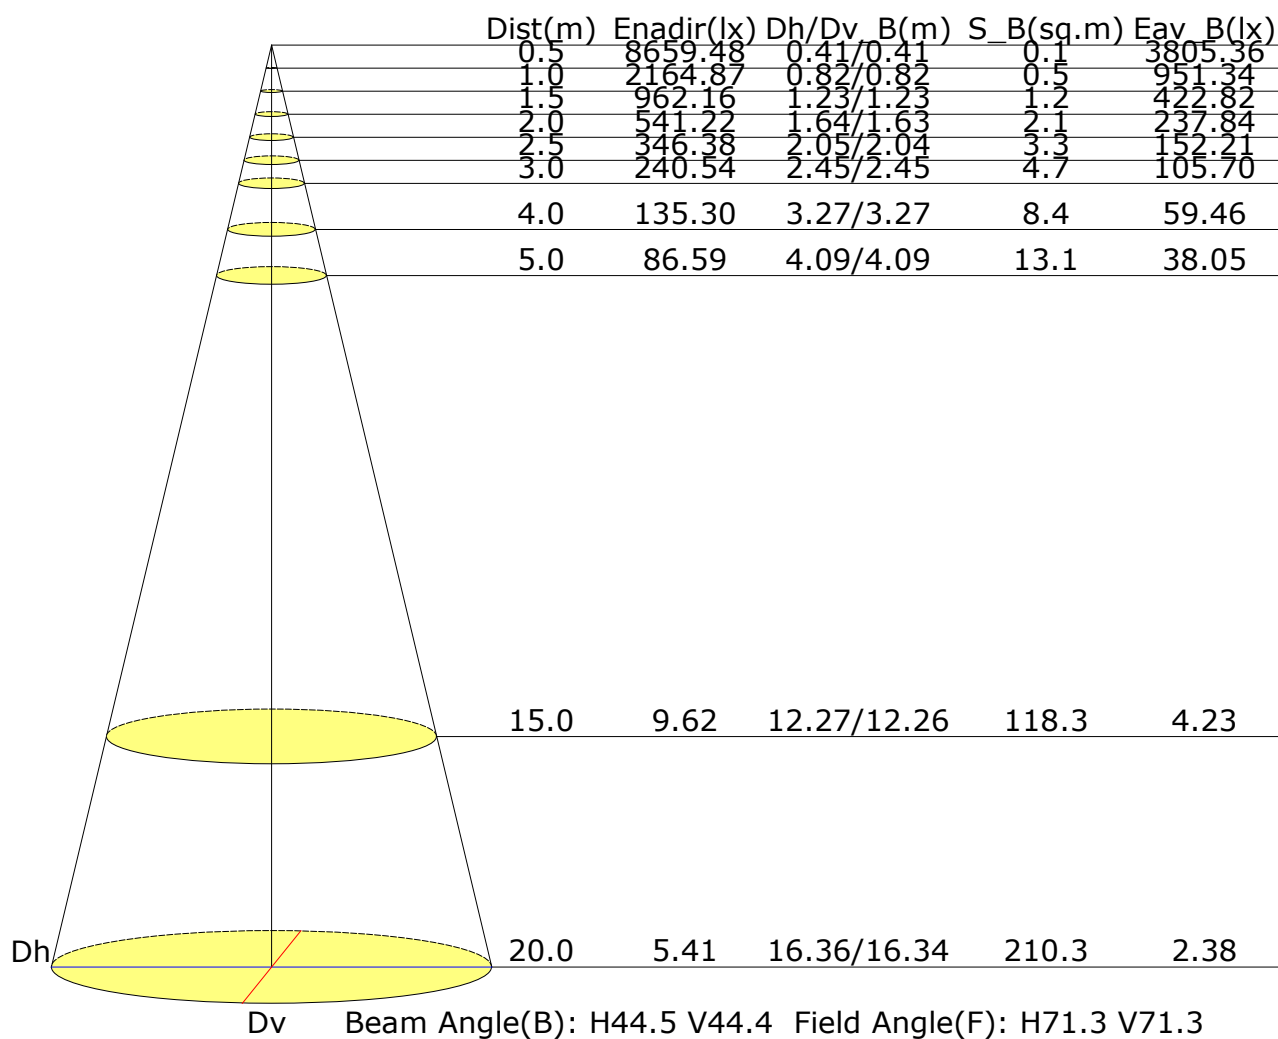

## Vertical IsoLux Plot

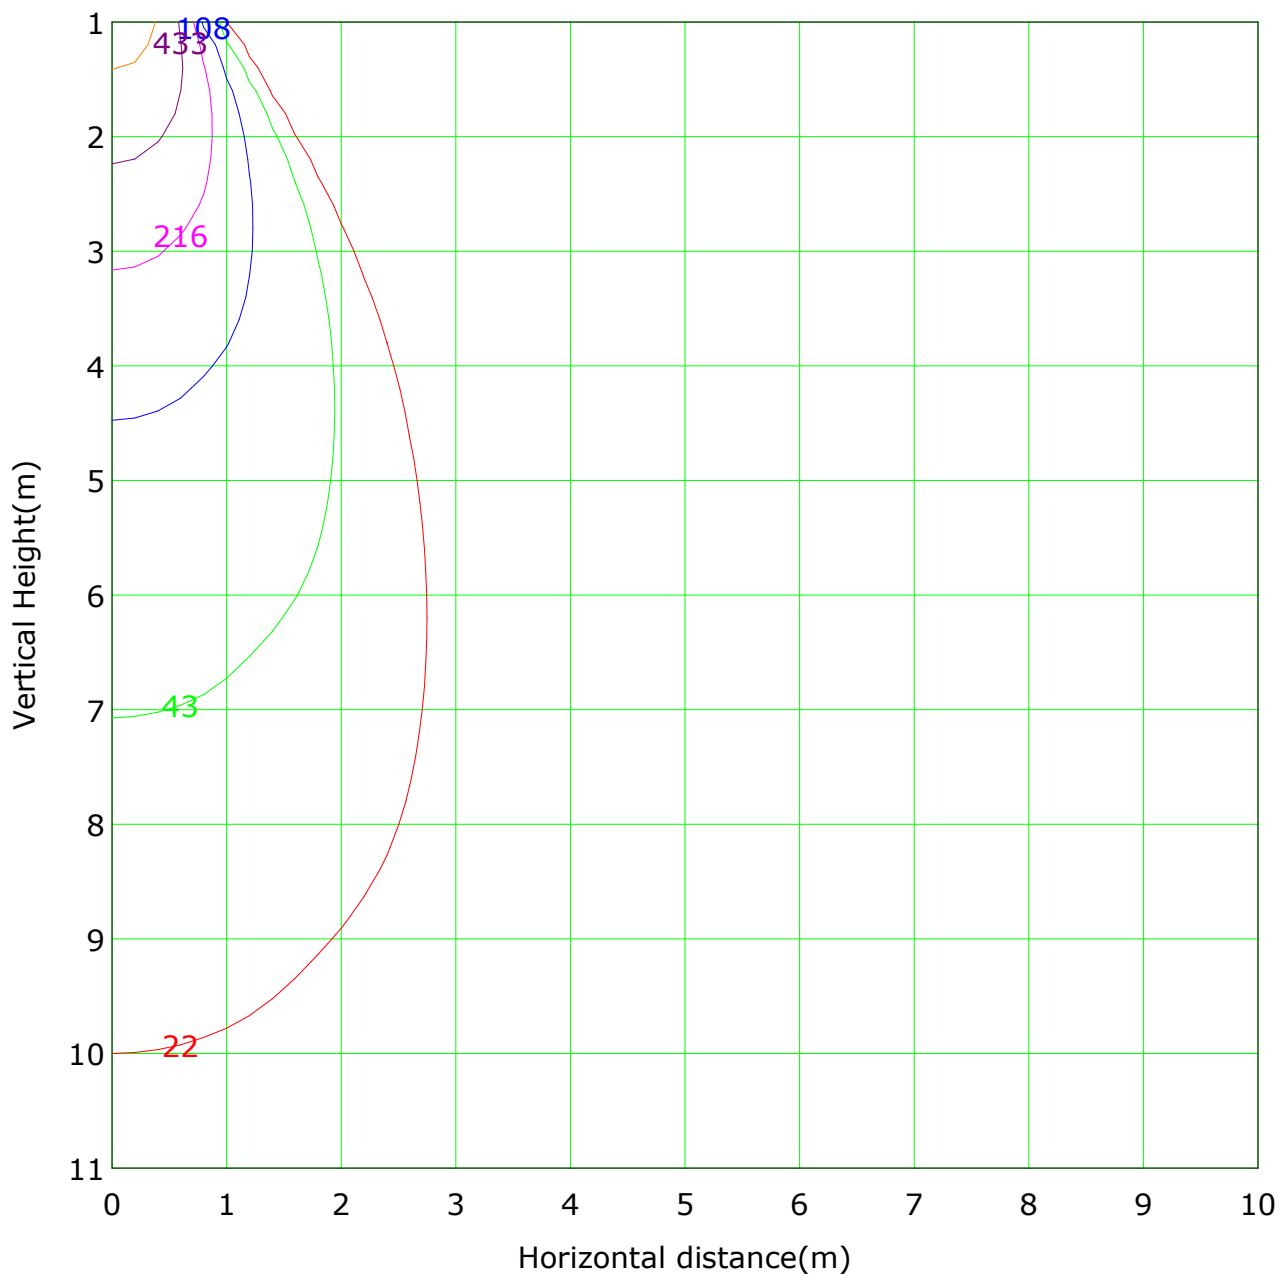


Lowest(m): 1.0m   Highest(m): 11.0m   Max Lux: 2164.9 lx  
— ( 1%): 21.6 lx   — ( 2%): 43.3 lx  
— ( 5%): 108.2 lx   — ( 10%): 216.5 lx  
— ( 20%): 433.0 lx   — ( 50%): 1082.4 lx  
— (100%): 2164.9 lx

C Plane (°): 0.0-180.0: 180.0  
Test Lab:  
Test Type: TYPE C  
Temperature:  
Operator:

Gamma Plane (°): 0.0-90.0: 1.0  
Test Device: CHL-6E  
Distance: 3.010 m  
Humidity:  
Inspector:

Gamma Plane (°):0.0-90.0:1.0  
Test Device: CHL-6E  
Distance: 3.010 m  
Humidity:  
Inspector:

## The Average Illuminance Effective Figure

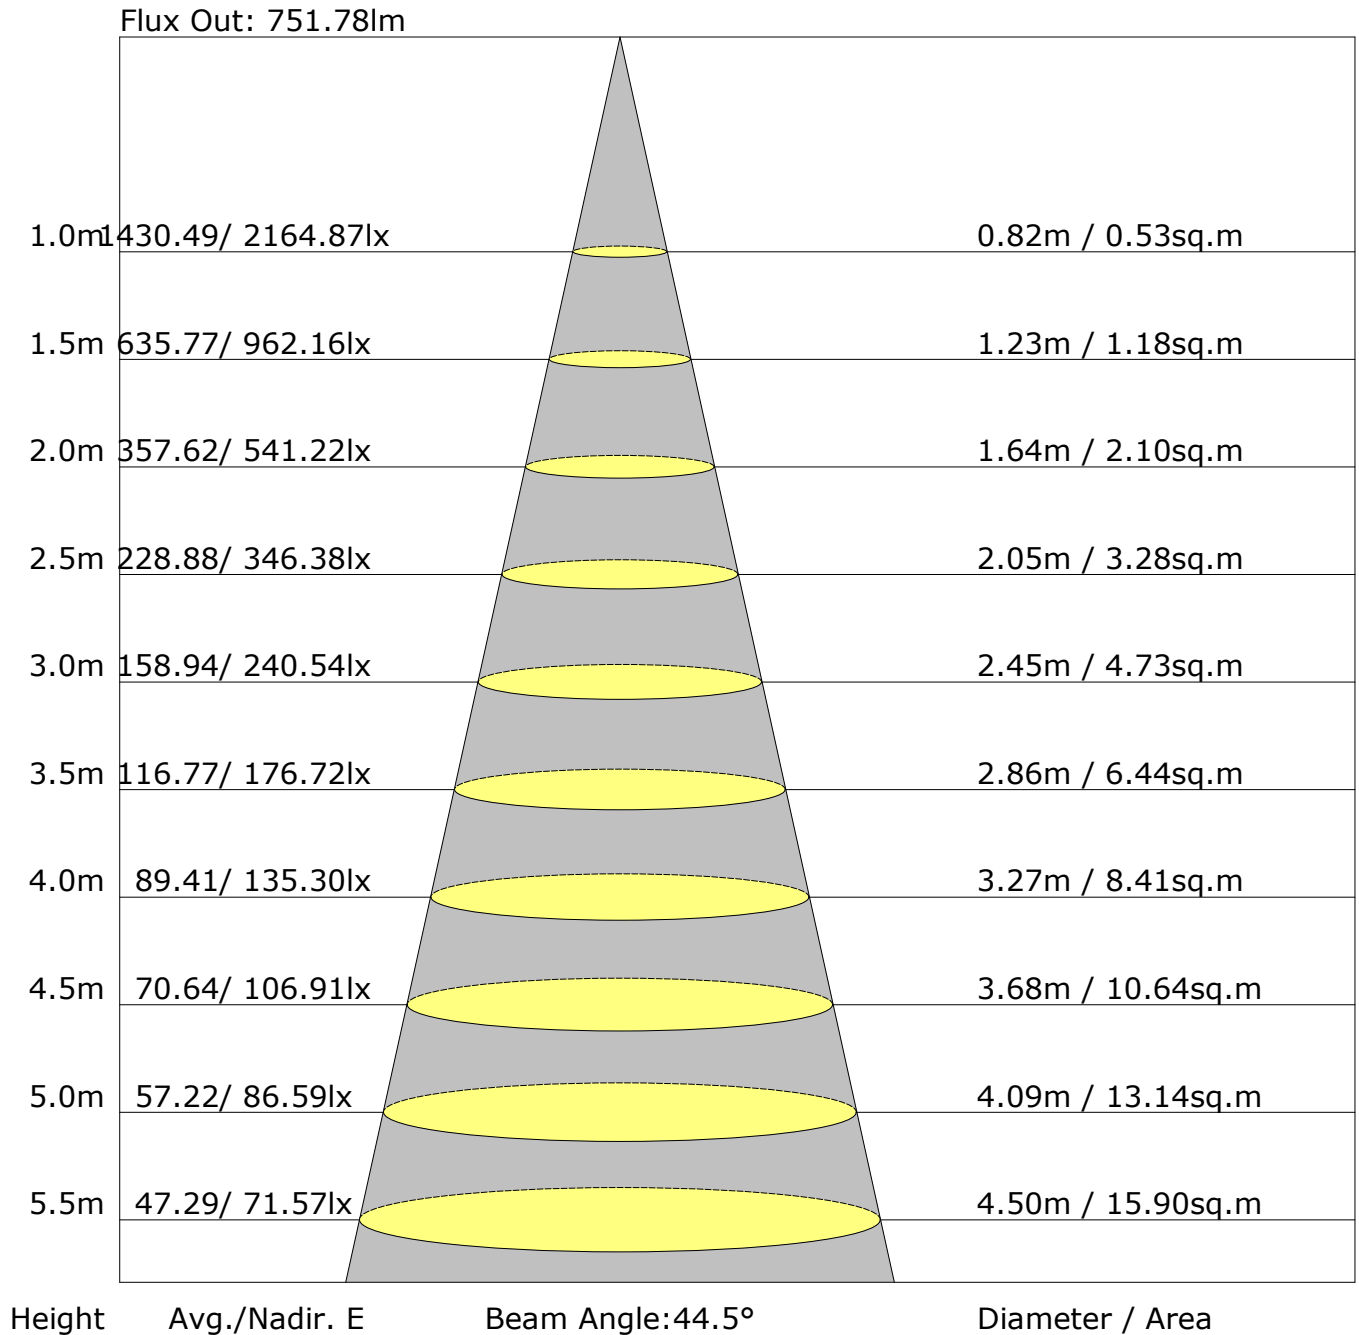

## UGR Table

|                                                    |                  |      |      |      |      |                |      |      |      |      |
|----------------------------------------------------|------------------|------|------|------|------|----------------|------|------|------|------|
| Reflectance:                                       |                  |      |      |      |      |                |      |      |      |      |
| Ceiling (cavity)                                   | 0.7              | 0.7  | 0.5  | 0.5  | 0.3  | 0.7            | 0.7  | 0.5  | 0.5  | 0.3  |
| Wall                                               | 0.5              | 0.3  | 0.5  | 0.3  | 0.3  | 0.5            | 0.3  | 0.5  | 0.3  | 0.3  |
| Reference plane                                    | 0.2              | 0.2  | 0.2  | 0.2  | 0.2  | 0.2            | 0.2  | 0.2  | 0.2  | 0.2  |
| Room dimensions                                    | Viewed crosswise |      |      |      |      | Viewed endwise |      |      |      |      |
| X=2H Y=2H                                          | 18.5             | 19.3 | 18.7 | 19.5 | 19.7 | 18.0           | 18.8 | 18.2 | 19.0 | 19.2 |
| 3H                                                 | 18.8             | 19.5 | 19.1 | 19.8 | 20.0 | 18.3           | 19.1 | 18.6 | 19.3 | 19.5 |
| 4H                                                 | 19.0             | 19.7 | 19.3 | 19.9 | 20.2 | 18.5           | 19.2 | 18.8 | 19.5 | 19.7 |
| 6H                                                 | 19.1             | 19.7 | 19.4 | 20.0 | 20.3 | 18.6           | 19.3 | 19.0 | 19.6 | 19.8 |
| 8H                                                 | 19.2             | 19.8 | 19.5 | 20.1 | 20.4 | 18.7           | 19.3 | 19.0 | 19.6 | 19.9 |
| 12H                                                | 19.2             | 19.8 | 19.5 | 20.1 | 20.4 | 18.7           | 19.3 | 19.1 | 19.6 | 19.9 |
| X=4H Y=2H                                          | 18.5             | 19.2 | 18.8 | 19.4 | 19.7 | 18.0           | 18.7 | 18.3 | 19.0 | 19.2 |
| 3H                                                 | 19.0             | 19.6 | 19.3 | 19.9 | 20.2 | 18.5           | 19.1 | 18.9 | 19.4 | 19.8 |
| 4H                                                 | 19.3             | 19.8 | 19.6 | 20.1 | 20.5 | 18.8           | 19.4 | 19.2 | 19.7 | 20.1 |
| 6H                                                 | 19.5             | 19.9 | 19.9 | 20.3 | 20.7 | 19.1           | 19.5 | 19.5 | 19.9 | 20.3 |
| 8H                                                 | 19.6             | 20.0 | 20.0 | 20.4 | 20.8 | 19.1           | 19.6 | 19.6 | 19.9 | 20.4 |
| 12H                                                | 19.6             | 20.0 | 20.1 | 20.4 | 20.8 | 19.2           | 19.6 | 19.6 | 20.0 | 20.4 |
| X=8H Y=4H                                          | 19.3             | 19.7 | 19.7 | 20.1 | 20.5 | 18.9           | 19.3 | 19.3 | 19.7 | 20.1 |
| 6H                                                 | 19.6             | 20.0 | 20.1 | 20.4 | 20.8 | 19.2           | 19.6 | 19.7 | 20.0 | 20.4 |
| 8H                                                 | 19.8             | 20.1 | 20.2 | 20.5 | 21.0 | 19.4           | 19.7 | 19.8 | 20.1 | 20.6 |
| 12H                                                | 19.9             | 20.1 | 20.4 | 20.6 | 21.1 | 19.5           | 19.7 | 19.9 | 20.2 | 20.7 |
| X=12H Y=4H                                         | 19.3             | 19.7 | 19.7 | 20.1 | 20.5 | 18.9           | 19.3 | 19.3 | 19.7 | 20.1 |
| 6H                                                 | 19.6             | 19.9 | 20.1 | 20.4 | 20.8 | 19.2           | 19.5 | 19.7 | 20.0 | 20.5 |
| 8H                                                 | 19.8             | 20.0 | 20.3 | 20.5 | 21.0 | 19.4           | 19.7 | 19.9 | 20.1 | 20.6 |
| Variations with the observer position at spacings: |                  |      |      |      |      |                |      |      |      |      |
| S=1.0H                                             | +3.7/-2.1        |      |      |      |      | +3.5/-1.9      |      |      |      |      |
| S=1.5H                                             | +6.1/-2.5        |      |      |      |      | +5.9/-2.3      |      |      |      |      |
| S=2.0H                                             | +8.0/-3.0        |      |      |      |      | +7.7/-2.8      |      |      |      |      |

Calculate in accordance with CIE Pub.117. The table is revised with  $1285\text{lm}$  ( $8\log(F/F_0) = 0.9$ ).

C Plane (°):0.0-180.0: 180.0  
Test Lab:  
Test Type: TYPE C  
Temperature:  
Operator:

Gamma Plane (°):0.0-90.0:1.0  
Test Device: CHL-6E  
Distance: 3.010 m  
Humidity:  
Inspector:

**FLUX DISTRIBUTION TABLE BASED ON THE IESNA LUMINAIRE CLASSIFICATION SYSTEM**

|  | ZONE           | LUMENS | % LAMP LUMENS |
|--|----------------|--------|---------------|
|  | FORWARD LIGHT  | 659    | 51.3          |
|  | FL ( 0°-30°)   | 528    | 41.1          |
|  | FM (30°-60°)   | 118    | 9.1           |
|  | FH (60°-80°)   | 13     | 1.0           |
|  | FVH (80°-90°)  | 1      | 0.1           |
|  | BACK LIGHT     | 626    | 48.7          |
|  | BL ( 0°-30°)   | 511    | 39.8          |
|  | BM (30°-60°)   | 101    | 7.9           |
|  | BH (60°-80°)   | 12     | 0.9           |
|  | BVH (80°-90°)  | 1      | 0.1           |
|  | UP LIGHT       | 0      | 0.0           |
|  | UL (90°-100°)  | 0      | 0.0           |
|  | UH (100°-180°) | 0      | 0.0           |
|  | TRAPPED LIGHT  | NA     | NA            |

| BUG(Backlight,Uplight,Glare) Rating Base On TM-15-07             |          |
|------------------------------------------------------------------|----------|
| Asymmetrical Luminaire Types<br>(Type I,II,III,IV)               | B2 U0 G0 |
| Quadrilateral Symmetrical Luminaire Types<br>(Type V,Area Light) | B2 U0 G0 |

C Plane (°):0.0-180.0: 180.0  
Test Lab:  
Test Type: TYPE C  
Temperature:  
Operator:

Gamma Plane (°):0.0-90.0:1.0  
Test Device: CHL-6E  
Distance: 3.010 m  
Humidity:  
Inspector:

## Zonal Lumen

| Gamma<br>[°] | I <sub>mean</sub><br>[cd] | Zonal Flux<br>[lm] | Sum Zonal Flux<br>[lm] | Rel Zonal Flux<br>[%] | Sum Rel Zonal Flux<br>[%] |
|--------------|---------------------------|--------------------|------------------------|-----------------------|---------------------------|
| 0.0-1.0      | 2163.5                    | 2.1                | 2.1                    | 0.16                  | 0.16                      |
| 1.0-2.0      | 2158.0                    | 6.2                | 8.3                    | 0.48                  | 0.64                      |
| 2.0-3.0      | 2146.9                    | 10.3               | 18.5                   | 0.80                  | 1.44                      |
| 3.0-4.0      | 2130.7                    | 14.3               | 32.8                   | 1.11                  | 2.55                      |
| 4.0-5.0      | 2109.8                    | 18.2               | 51.0                   | 1.41                  | 3.96                      |
| 5.0-6.0      | 2084.5                    | 21.9               | 72.9                   | 1.70                  | 5.67                      |
| 6.0-7.0      | 2054.4                    | 25.5               | 98.4                   | 1.98                  | 7.65                      |
| 7.0-8.0      | 2019.3                    | 28.9               | 127.3                  | 2.25                  | 9.90                      |
| 8.0-9.0      | 1979.8                    | 32.1               | 159.4                  | 2.50                  | 12.40                     |
| 9.0-10.0     | 1937.0                    | 35.1               | 194.4                  | 2.73                  | 15.13                     |
| 10.0-11.0    | 1891.5                    | 37.8               | 232.2                  | 2.94                  | 18.07                     |
| 11.0-12.0    | 1844.0                    | 40.3               | 272.5                  | 3.14                  | 21.20                     |
| 12.0-13.0    | 1794.0                    | 42.6               | 315.1                  | 3.31                  | 24.52                     |
| 13.0-14.0    | 1740.6                    | 44.6               | 359.7                  | 3.47                  | 27.98                     |
| 14.0-15.0    | 1683.3                    | 46.2               | 405.9                  | 3.60                  | 31.58                     |
| 15.0-16.0    | 1621.4                    | 47.5               | 453.4                  | 3.70                  | 35.28                     |
| 16.0-17.0    | 1553.6                    | 48.4               | 501.8                  | 3.76                  | 39.04                     |
| 17.0-18.0    | 1479.6                    | 48.8               | 550.6                  | 3.80                  | 42.84                     |
| 18.0-19.0    | 1400.0                    | 48.7               | 599.3                  | 3.79                  | 46.63                     |
| 19.0-20.0    | 1316.4                    | 48.2               | 647.5                  | 3.75                  | 50.38                     |
| 20.0-21.0    | 1230.7                    | 47.3               | 694.8                  | 3.68                  | 54.06                     |
| 21.0-22.0    | 1144.4                    | 46.0               | 740.7                  | 3.58                  | 57.63                     |
| 22.0-23.0    | 1059.0                    | 44.4               | 785.2                  | 3.46                  | 61.09                     |
| 23.0-24.0    | 976.1                     | 42.7               | 827.9                  | 3.32                  | 64.41                     |
| 24.0-25.0    | 896.0                     | 40.7               | 868.6                  | 3.17                  | 67.58                     |
| 25.0-26.0    | 819.0                     | 38.7               | 907.3                  | 3.01                  | 70.59                     |
| 26.0-27.0    | 745.7                     | 36.5               | 943.8                  | 2.84                  | 73.43                     |
| 27.0-28.0    | 675.9                     | 34.2               | 978.0                  | 2.66                  | 76.09                     |
| 28.0-29.0    | 609.1                     | 31.9               | 1009.9                 | 2.48                  | 78.57                     |
| 29.0-30.0    | 545.2                     | 29.4               | 1039.3                 | 2.29                  | 80.86                     |
| 30.0-31.0    | 484.1                     | 26.9               | 1066.3                 | 2.10                  | 82.96                     |
| 31.0-32.0    | 425.6                     | 24.4               | 1090.6                 | 1.90                  | 84.86                     |
| 32.0-33.0    | 369.7                     | 21.8               | 1112.4                 | 1.69                  | 86.55                     |
| 33.0-34.0    | 317.2                     | 19.2               | 1131.6                 | 1.49                  | 88.05                     |
| 34.0-35.0    | 268.4                     | 16.7               | 1148.3                 | 1.30                  | 89.34                     |
| 35.0-36.0    | 223.9                     | 14.3               | 1162.5                 | 1.11                  | 90.45                     |

C Plane (°):0.0-180.0: 180.0  
Test Lab:  
Test Type: TYPE C  
Temperature:  
Operator:

Gamma Plane (°):0.0-90.0:1.0  
Test Device: CHL-6E  
Distance: 3.010 m  
Humidity:  
Inspector:

## Zonal Lumen (Continue 1)

| Gamma<br>[°] | I <sub>mean</sub><br>[cd] | Zonal Flux<br>[lm] | Sum Zonal Flux<br>[lm] | Rel Zonal Flux<br>[%] | Sum Rel Zonal Flux<br>[%] |
|--------------|---------------------------|--------------------|------------------------|-----------------------|---------------------------|
| 36.0-37.0    | 184.4                     | 12.0               | 1174.6                 | 0.94                  | 91.39                     |
| 37.0-38.0    | 150.1                     | 10.0               | 1184.6                 | 0.78                  | 92.17                     |
| 38.0-39.0    | 121.3                     | 8.3                | 1192.9                 | 0.64                  | 92.81                     |
| 39.0-40.0    | 97.7                      | 6.8                | 1199.7                 | 0.53                  | 93.34                     |
| 40.0-41.0    | 79.2                      | 5.6                | 1205.3                 | 0.44                  | 93.78                     |
| 41.0-42.0    | 65.0                      | 4.7                | 1210.1                 | 0.37                  | 94.15                     |
| 42.0-43.0    | 54.7                      | 4.1                | 1214.1                 | 0.32                  | 94.46                     |
| 43.0-44.0    | 47.3                      | 3.6                | 1217.7                 | 0.28                  | 94.74                     |
| 44.0-45.0    | 42.0                      | 3.2                | 1220.9                 | 0.25                  | 94.99                     |
| 45.0-46.0    | 38.3                      | 3.0                | 1223.9                 | 0.23                  | 95.23                     |
| 46.0-47.0    | 35.7                      | 2.8                | 1226.7                 | 0.22                  | 95.45                     |
| 47.0-48.0    | 33.7                      | 2.7                | 1229.5                 | 0.21                  | 95.66                     |
| 48.0-49.0    | 32.2                      | 2.6                | 1232.1                 | 0.21                  | 95.86                     |
| 49.0-50.0    | 31.0                      | 2.6                | 1234.7                 | 0.20                  | 96.07                     |
| 50.0-51.0    | 30.0                      | 2.5                | 1237.2                 | 0.20                  | 96.26                     |
| 51.0-52.0    | 29.1                      | 2.5                | 1239.7                 | 0.19                  | 96.46                     |
| 52.0-53.0    | 28.2                      | 2.4                | 1242.2                 | 0.19                  | 96.65                     |
| 53.0-54.0    | 27.4                      | 2.4                | 1244.6                 | 0.19                  | 96.84                     |
| 54.0-55.0    | 26.6                      | 2.4                | 1247.0                 | 0.18                  | 97.02                     |
| 55.0-56.0    | 25.7                      | 2.3                | 1249.3                 | 0.18                  | 97.20                     |
| 56.0-57.0    | 24.8                      | 2.3                | 1251.6                 | 0.18                  | 97.38                     |
| 57.0-58.0    | 23.8                      | 2.2                | 1253.7                 | 0.17                  | 97.55                     |
| 58.0-59.0    | 22.6                      | 2.1                | 1255.9                 | 0.16                  | 97.71                     |
| 59.0-60.0    | 21.5                      | 2.0                | 1257.9                 | 0.16                  | 97.87                     |
| 60.0-61.0    | 20.3                      | 1.9                | 1259.8                 | 0.15                  | 98.02                     |
| 61.0-62.0    | 19.3                      | 1.9                | 1261.7                 | 0.14                  | 98.17                     |
| 62.0-63.0    | 18.3                      | 1.8                | 1263.5                 | 0.14                  | 98.30                     |
| 63.0-64.0    | 17.4                      | 1.7                | 1265.2                 | 0.13                  | 98.44                     |
| 64.0-65.0    | 16.5                      | 1.6                | 1266.8                 | 0.13                  | 98.56                     |
| 65.0-66.0    | 15.6                      | 1.6                | 1268.4                 | 0.12                  | 98.69                     |
| 66.0-67.0    | 14.9                      | 1.5                | 1269.9                 | 0.12                  | 98.80                     |
| 67.0-68.0    | 14.1                      | 1.4                | 1271.3                 | 0.11                  | 98.91                     |
| 68.0-69.0    | 13.2                      | 1.3                | 1272.6                 | 0.10                  | 99.02                     |
| 69.0-70.0    | 12.5                      | 1.3                | 1273.9                 | 0.10                  | 99.12                     |
| 70.0-71.0    | 11.8                      | 1.2                | 1275.1                 | 0.10                  | 99.21                     |
| 71.0-72.0    | 11.0                      | 1.1                | 1276.3                 | 0.09                  | 99.30                     |

C Plane (°):0.0-180.0: 180.0  
Test Lab:  
Test Type: TYPE C  
Temperature:  
Operator:

Gamma Plane (°):0.0-90.0:1.0  
Test Device: CHL-6E  
Distance: 3.010 m  
Humidity:  
Inspector:

Gamma Plane (°):0.0-90.0:1.0  
Test Device: CHL-6E  
Distance: 3.010 m  
Humidity:  
Inspector:

## Candlepower Table

Unit: cd

| G\C   | C0.0   | C180.0 |  |  |  |  |  |  |  |  |
|-------|--------|--------|--|--|--|--|--|--|--|--|
| G0.0  | 2164.9 | 2164.9 |  |  |  |  |  |  |  |  |
| G1.0  | 2163.5 | 2160.8 |  |  |  |  |  |  |  |  |
| G2.0  | 2157.2 | 2150.3 |  |  |  |  |  |  |  |  |
| G3.0  | 2146.7 | 2133.5 |  |  |  |  |  |  |  |  |
| G4.0  | 2131.4 | 2111.3 |  |  |  |  |  |  |  |  |
| G5.0  | 2112.5 | 2084.1 |  |  |  |  |  |  |  |  |
| G6.0  | 2088.9 | 2052.6 |  |  |  |  |  |  |  |  |
| G7.0  | 2058.9 | 2017.4 |  |  |  |  |  |  |  |  |
| G8.0  | 2021.2 | 1979.7 |  |  |  |  |  |  |  |  |
| G9.0  | 1978.4 | 1940.0 |  |  |  |  |  |  |  |  |
| G10.0 | 1931.8 | 1897.9 |  |  |  |  |  |  |  |  |
| G11.0 | 1884.0 | 1852.4 |  |  |  |  |  |  |  |  |
| G12.0 | 1835.9 | 1803.6 |  |  |  |  |  |  |  |  |
| G13.0 | 1787.3 | 1749.3 |  |  |  |  |  |  |  |  |
| G14.0 | 1734.9 | 1691.0 |  |  |  |  |  |  |  |  |
| G15.0 | 1678.9 | 1628.4 |  |  |  |  |  |  |  |  |
| G16.0 | 1618.2 | 1560.1 |  |  |  |  |  |  |  |  |
| G17.0 | 1550.5 | 1485.8 |  |  |  |  |  |  |  |  |
| G18.0 | 1475.9 | 1406.2 |  |  |  |  |  |  |  |  |
| G19.0 | 1397.1 | 1320.8 |  |  |  |  |  |  |  |  |
| G20.0 | 1314.8 | 1233.1 |  |  |  |  |  |  |  |  |
| G21.0 | 1231.4 | 1143.5 |  |  |  |  |  |  |  |  |
| G22.0 | 1148.9 | 1054.0 |  |  |  |  |  |  |  |  |
| G23.0 | 1066.6 | 966.8  |  |  |  |  |  |  |  |  |
| G24.0 | 987.3  | 883.6  |  |  |  |  |  |  |  |  |
| G25.0 | 910.0  | 803.3  |  |  |  |  |  |  |  |  |
| G26.0 | 834.6  | 728.0  |  |  |  |  |  |  |  |  |
| G27.0 | 762.6  | 657.5  |  |  |  |  |  |  |  |  |
| G28.0 | 694.5  | 589.2  |  |  |  |  |  |  |  |  |
| G29.0 | 629.7  | 522.9  |  |  |  |  |  |  |  |  |
| G30.0 | 568.3  | 459.9  |  |  |  |  |  |  |  |  |
| G31.0 | 509.6  | 398.6  |  |  |  |  |  |  |  |  |
| G32.0 | 452.7  | 341.4  |  |  |  |  |  |  |  |  |
| G33.0 | 396.4  | 288.4  |  |  |  |  |  |  |  |  |
| G34.0 | 343.5  | 240.4  |  |  |  |  |  |  |  |  |
| G35.0 | 293.1  | 196.8  |  |  |  |  |  |  |  |  |
| G36.0 | 246.4  | 159.1  |  |  |  |  |  |  |  |  |

C Plane (°):0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0

Test Device: CHL-6E

Distance: 3.010 m

Humidity:

Inspector:

## Candlepower Table (Continue 1)

Unit: cd

| G\C   | C0.0  | C180.0 |  |  |  |  |  |  |  |  |
|-------|-------|--------|--|--|--|--|--|--|--|--|
| G37.0 | 204.9 | 127.0  |  |  |  |  |  |  |  |  |
| G38.0 | 167.4 | 101.2  |  |  |  |  |  |  |  |  |
| G39.0 | 135.1 | 81.4   |  |  |  |  |  |  |  |  |
| G40.0 | 108.1 | 66.4   |  |  |  |  |  |  |  |  |
| G41.0 | 86.3  | 55.8   |  |  |  |  |  |  |  |  |
| G42.0 | 70.0  | 48.0   |  |  |  |  |  |  |  |  |
| G43.0 | 58.0  | 42.8   |  |  |  |  |  |  |  |  |
| G44.0 | 49.7  | 38.7   |  |  |  |  |  |  |  |  |
| G45.0 | 43.5  | 36.0   |  |  |  |  |  |  |  |  |
| G46.0 | 39.6  | 33.9   |  |  |  |  |  |  |  |  |
| G47.0 | 36.9  | 32.3   |  |  |  |  |  |  |  |  |
| G48.0 | 34.8  | 30.9   |  |  |  |  |  |  |  |  |
| G49.0 | 33.3  | 29.7   |  |  |  |  |  |  |  |  |
| G50.0 | 32.0  | 28.8   |  |  |  |  |  |  |  |  |
| G51.0 | 31.1  | 28.1   |  |  |  |  |  |  |  |  |
| G52.0 | 29.7  | 27.3   |  |  |  |  |  |  |  |  |
| G53.0 | 28.8  | 26.7   |  |  |  |  |  |  |  |  |
| G54.0 | 27.8  | 26.3   |  |  |  |  |  |  |  |  |
| G55.0 | 26.7  | 25.5   |  |  |  |  |  |  |  |  |
| G56.0 | 25.8  | 24.6   |  |  |  |  |  |  |  |  |
| G57.0 | 24.8  | 24.0   |  |  |  |  |  |  |  |  |
| G58.0 | 23.6  | 22.7   |  |  |  |  |  |  |  |  |
| G59.0 | 22.5  | 21.6   |  |  |  |  |  |  |  |  |
| G60.0 | 21.5  | 20.4   |  |  |  |  |  |  |  |  |
| G61.0 | 20.1  | 19.4   |  |  |  |  |  |  |  |  |
| G62.0 | 19.2  | 18.5   |  |  |  |  |  |  |  |  |
| G63.0 | 18.0  | 17.4   |  |  |  |  |  |  |  |  |
| G64.0 | 17.6  | 16.5   |  |  |  |  |  |  |  |  |
| G65.0 | 16.5  | 15.5   |  |  |  |  |  |  |  |  |
| G66.0 | 15.6  | 14.7   |  |  |  |  |  |  |  |  |
| G67.0 | 15.0  | 14.1   |  |  |  |  |  |  |  |  |
| G68.0 | 14.3  | 13.1   |  |  |  |  |  |  |  |  |
| G69.0 | 13.4  | 12.2   |  |  |  |  |  |  |  |  |
| G70.0 | 12.9  | 11.6   |  |  |  |  |  |  |  |  |
| G71.0 | 12.0  | 10.8   |  |  |  |  |  |  |  |  |
| G72.0 | 11.3  | 10.1   |  |  |  |  |  |  |  |  |
| G73.0 | 10.5  | 9.3    |  |  |  |  |  |  |  |  |

C Plane (°):0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0

Test Device: CHL-6E

Distance: 3.010 m

Humidity:

Inspector:

Unit: cd

Inspector: